

NFPA 61
Standard for the
Prevention of Fires
and Dust Explosions
in Agricultural and
Food Products Facilities
1995 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable federal, state and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision—This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference—Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription—A. Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rule-making process. B. Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

3. Scope of License Grant—The terms and conditions set forth above do not extend to the index to this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accept any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document, and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

Copyright © 1995 NFPA. All Rights Reserved

NFPA 61
Standard for the Prevention of
Fires and Dust Explosions in
Agricultural and Food Products Facilities
1995 Edition

This edition of NFPA 61, *Standard for the Prevention of Fires and Dust Explosions in Agricultural and Food Products Facilities*, was prepared by the Technical Committee on Agricultural Dusts and acted on by the National Fire Protection Association, Inc., at its Annual Meeting held May 22-25, 1995, in Denver, CO. It was issued by the Standards Council on July 21, 1995, with an effective date of August 11, 1995.

This edition of NFPA 61 was approved as an American National Standard on August 11, 1995.

Origin and Development of NFPA 61

The NFPA 61 standard had its origin back in 1923 when standards development for dust explosions in grain terminals and flour mills was begun. Over the past 70 years, there have been over 14 editions of the various NFPA 61 standards. This latest edition combines the NFPA 61A, *Standard for the Prevention of Fire and Dust Explosions in Facilities Manufacturing and Handling Starch*, NFPA 61B, *Standard for the Prevention of Fires and Explosions in Grain Elevators and Facilities Handling Bulk Raw Agricultural Commodities*, NFPA 61C, *Standard for the Prevention of Fire and Dust Explosions in Feed Mills*, and NFPA 61D, *Standard for the Prevention of Fire and Dust Explosions in the Milling of Agricultural Commodities for Human Consumption* documents into a single standard. The scope of affected industries was expanded to help fill needs of other agricultural dust-related industries that have fire and dust explosion hazards when handling agricultural materials.

Previously, NFPA 61B was adopted by the Association in 1969 as a tentative standard to replace three former standards: NFPA 61B, *Code for the Prevention of Dust Explosions in Terminal Grain Elevators*; NFPA 64, *Code for the Prevention of Dust Ignitions in Country Grain Elevators*; and NFPA 661, *Suction and Venting in Grain Elevators*. In addition, NFPA 93, *Standard for Dehydrators and Dryers for Agricultural Products*, was withdrawn in 1968 and its text was incorporated as a chapter in NFPA 61B.

The 1969 tentative edition of NFPA 61B was officially adopted at the 1970 NFPA Annual Meeting. An amended edition was adopted in 1973. In 1980, the standard was further revised to reflect the series of disastrous grain elevator explosions that occurred in late 1977 and early 1978. Additional amendments and style changes were made in 1984 and 1989.

The Technical Committee on Agricultural Dusts compared the four existing standards, 1989 editions, with current technology and industrial practice. They determined that many sections of the four standards duplicated each other, and a major revision was necessary to consolidate the four standards into one comprehensive standard. In order to reduce the difficulty of using four separate but similar standards, especially in locations where more than one standard applied, the Committee decided to combine all four standards into a single complete standard covering the full range of requirements for good design, operating practice, and protective features. The Committee believes that these changes also make the revised code more usable, adoptable, and enforceable.

At a Committee meeting in September 1992, the Committee on Agricultural Dusts began work on consolidating the four separate agricultural standards (NFPA 61A, 61B, 61C, and 61D) into one comprehensive standard. These four standards addressed the handling of agricultural commodities in starch manufacturing facilities, grain elevators and such handling facilities, feed mills, and facilities that mill agricultural commodities for human consumption. They prepared this new standard that would apply to all types of facilities that handle, process, store, or manufacture agricultural and food products. The Committee reviewed drafts of the condensed standard and continued to revise it at Committee meetings held January 1993, June 1993, September 1993, March 1994, and November 1994.

Technical Committee on Agricultural Dusts

Anthony G. Martino, *Chair*
Cargill, Inc., MN

James R. Allen, Research Products Co., KS
Joe R. Barton, Nat'l Starch and Chemical Co., IN
Wayne R. Bellinger, ConAgra Grain Cos., NE
 Rep. Assn. of Operative Millers
Delwyn D. Bluhm, Inst. for Physical Research &
 Technology, IA
Duane W. Brown, Ranger Insurance Co., PA
Brian L. Bursiek, American Feed Industry Assn., VA
Clayton S. Ellsworth, EBM Mill & Elevator Supply, NE
Jan M. Elzey, River Consulting, Inc., OH
William E. Engebretson, The Pillsbury Co., MN
John E. Heilman, Heilman Consulting Group, CO

Edward D. Leedy, Industrial Risk Insurers, IL
 Rep. Industrial Risk Insurers
James E. Maness, Bunge Corp., MO
 Rep. Grain Elevator & Processing Society
Robert J. Moore, A E Staley Mfr. Co., IL
 Rep. Corn Refiners Assn., Inc.
Charles W. Salb, American Risk Consultants Corp., MN
Lee M. Sargent, Todd & Sargent, Inc., IA
William E. Smith, Johnson & Higgins, MN
John Valiulis, Factory Mutual Research Corp., MA
B. J. Walker, Walker & Assoc., MO
Hans Wanzenried, Buhler, Inc., MN
Jerry S. Wodzinski, Underwriters Laboratories Inc., IL

Alternates

Robert H. Dutson, Johnson & Higgins, NY
 (Alt. to W. E. Smith)
Thomas E. Frank, Factory Mutual Engr. Assn., WA
 (Alt. to J. Valiulis)
Larry K. Jackson, Louis Dreyfus Corp., KS
 (Alt. to J. E. Maness)
Douglas W. Jensen, Cargill, Inc., MN
 (Alt. to A. G. Martino)

Robert W. Nelson, Industrial Risk Insurers, CT
 (Alt. to E. D. Leedy)
Carl Snider, Research Products Co., KS
 (Alt. to J. R. Allen)
Ned Gentry Weaver, Nat'l Starch and Chemical Co., IN
 (Alt. to J. R. Barton)

Martha H. Curtis, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on the prevention, control, and extinguishment of fire and explosions resulting from dusts produced by the processing, handling, and storage of grain, food, and other agricultural products. The Technical Committee also shall be responsible for requirements relating to the fire and explosion hazards associated with fumigation of bulk agricultural commodities at grain-handling facilities.

Contents

Chapter 1 General	61- 4	Chapter 9 Pneumatic Conveying	61-12
1-1 Scope	61- 4	9-1 General	61-12
1-2 Purpose	61- 4	9-2 General Design	61-12
1-3 Applicability	61- 4	9-3 Piping, Valves, and Blowers	61-12
1-4 Definitions	61- 4	9-4 Air-Material Separators	61-12
		9-5 Receiving and Shipping Conveyances	61-12
Chapter 2 Construction Requirements	61- 5	Chapter 10 Building Fire Protection	61-12
2-1 General Requirements	61- 5	10-1 Portable Fire Extinguishers	61-12
2-2 Interior Surfaces	61- 5	10-2 Automatic Sprinklers	61-12
2-3 Interior Wall Construction	61- 5	10-3 Supervisory Services	61-12
2-4 Means of Egress	61- 5	10-4 Standpipe and Hose	61-12
2-5 Bins, Tanks, and Silos	61- 6	10-5 Emergency Preplanning	61-13
2-6 Marine Towers	61- 6	10-6 Fire-Fighting Operations	61-13
Chapter 3 Ventilation and Venting	61- 6	Chapter 11 Supplemental Requirements	61-13
3-1 General	61- 6	11-1 Electrical Wiring and Equipment	61-13
3-2 Venting of Bins, Tanks, and Silos	61- 6	11-2 Hot Work	61-13
Chapter 4 Explosion Prevention, Relief, and Venting	61- 6	11-3 Spark-Producing Portable Power Tools and Propellant-Actuated Tools	61-14
4-1 General	61- 6	11-4 Static Electricity	61-14
4-2 Requirements for Enclosures	61- 6	11-5 Engine and Motor-Driven Equipment	61-14
4-3 Requirements for Equipment	61- 6	11-6 Smoking	61-14
Chapter 5 Equipment	61- 7	11-7 Storage of Oils, Flammable Liquids, and LP-Gas	61-14
5-1 Bearings	61- 7	11-8 Outside Contractors	61-14
5-2 Drive Belts	61- 7	11-9 Warning Signs	61-14
5-3 Conveyors, Spouts, and Throws of Material	61- 7	11-10 Miscellaneous Storage in Grain-Handling Facilities	61-14
5-4 Bucket Elevators (Legs)	61- 7		
5-5 Processing Machinery and Equipment	61- 8	Chapter 12 Referenced Publications	61-14
Chapter 6 Dryers	61- 8	Appendix A Explanatory Material	61-15
6-1 Dryers	61- 8	Appendix B Supplementary Information on Fire Protection	61-21
6-2 Grain Dryers	61- 8	Appendix C Supplemental Information on Fumigation	61-21
6-3 Product Dryers	61- 9	Appendix D Employee Health and Safety	61-21
6-4 Starch Dryers	61- 9	Appendix E Schematics of Typical Pneumatic Conveying Installations	61-22
6-5 Inspection and Tests	61-10	Appendix F Referenced Publications	61-25
Chapter 7 Heat Transfer Operations	61-10	Index	61-26
7-1 Heat Transfer Systems	61-10		
7-2 Comfort Heating	61-10		
Chapter 8 Dust Control	61-11		
8-1 Removal of Layered Agricultural Dust	61-11		
8-2 Dust Emissions	61-11		
8-3 Dust Collection Systems	61-11		

NFPA 61

Standard for the Prevention of Fires and Dust Explosions in Agricultural and Food Products Facilities

1995 Edition

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates explanatory material on that paragraph in Appendix A.

Information on referenced publications can be found in Chapter 12 and Appendix F.

Chapter 1 General

1-1 Scope.

1-1.1* This standard shall apply to the following:

(a) All facilities that handle, process, blend, mill, receive, load, ship, package, store, or unload dry agricultural bulk materials, their by-products, or dusts that include grains, oilseeds, agricultural seeds, legumes, sugar, spices, feeds, and other related materials;

(b) All facilities designed for manufacturing and handling starch, including drying, grinding, conveying, processing, packaging, and storage of dry or modified starch, and dry products and dusts generated from these processes; and

(c) Those seed preparation and meal-handling systems of oilseed processing plants not covered by NFPA 36, *Standard for Solvent Extraction Plants*.

1-1.2 This standard does not apply to oilseed extraction plants that are covered by NFPA 36, *Standard for Solvent Extraction Plants*.

1-2 Purpose.

1-2.1* The purpose of this standard is to prescribe requirements for safety to life and property from fire and explosion and to minimize the resulting damage if a fire or explosion occurs.

1-2.2 Equivalency. Nothing in this standard is intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety to those prescribed by this standard, provided technical documentation is made available to the authority having jurisdiction to demonstrate equivalency, and the system, method, or device is approved for the intended purpose.

1-3 Applicability. The provisions of this document are necessary to provide a reasonable level of protection from loss of life and property from fire and explosion. They reflect situations and the state of the art prevalent at the time the standard was issued.

Unless otherwise noted, it is not intended that the provisions of this document be applied to facilities, equipment, structures, or installations that were existing or approved for construction or installation prior to the effective date of

the document, except in those cases where it is determined by the authority having jurisdiction that the existing situation involves a distinct hazard to life or adjacent property.

Exception: The requirements of Chapter 11 shall apply to all facilities.

1-4 Definitions.

Agricultural Dust.* Any finely divided solid agricultural material 420 microns or smaller in diameter (material passing a U.S. No. 40 Standard Sieve) that presents a fire or explosion hazard when dispersed and ignited in air.

Approved.* Acceptable to the authority having jurisdiction.

Authority Having Jurisdiction.* The organization, office, or individual responsible for approving equipment, an installation, or a procedure.

Bulk Raw Grain. Bulk raw grain includes grain materials, such as cereal grains, oilseeds, and legumes, that have not undergone processing or size reduction. Cleaning or drying does not constitute processing.

Explosion. The bursting or rupture of an enclosure or container due to the development of internal pressure from a deflagration.

NOTE: For the purposes of this standard, the term explosion is equivalent to the word deflagration as identified in NFPA 68, *Guide for Venting of Deflagrations*.

Fire-Resistant Belting Materials. Those belts that meet Mine Safety and Health Administration (MSHA) 2G flame test for conveyor belting.

Hot Work. Hot work includes cutting and welding, grinding, brazing, and similar heat-producing processes.

Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation that maintains periodic inspection of production of labeled equipment or materials and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

Listed.* Equipment or materials included in a list published by an organization acceptable to the authority having jurisdiction and concerned with product evaluation that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

Marine Tower. Movable stand-alone gantry used for loading or unloading grain.

Ohms per Square. The term used to define electrical surface resistivity of a material.

Shall. Indicates a mandatory requirement.

Should. Indicates a recommendation or that which is advised but not required.

Starch. For the purposes of this standard, starch refers to the manufacture of starch products by the wet milling process.

Chapter 2 Construction Requirements

2-1 General Requirements.

2-1.1* All construction and design shall conform to applicable local, state, or national codes and shall be conducted according to good engineering practices.

2-1.2* Enclosures built to segregate dust explosion hazard areas from other areas shall be designed so that they will not fail before the explosion pressure is vented to a safe outside location.

2-1.3 Electrical wiring and power equipment shall meet all applicable requirements of NFPA 70, *National Electrical Code*®.

2-1.4* Masonry shall not be used for the construction of exterior walls or roofs in areas classified as Class II, Group G, Division 1, in NFPA 70, *National Electrical Code*.

Exception: Masonry walls shall be permitted if they are designed for explosion resistance to preclude failure of these walls before the explosion pressure can be vented safely to the outside.

2-1.5 Facilities designed for receiving, shipping, handling, and storing of bulk, raw agricultural commodities that are located in a separate structure from grain processing or manufacturing areas and their associated raw material, ingredient, production, and finished product bins shall be located and constructed in accordance with the requirements of 2-1.5.1 through 2-1.5.4.

2-1.5.1 Structures housing personnel-intensive areas not directly involved in operations such as, but not limited to, those involved exclusively in administrative or clerical personnel groups, grain inspection and weighing supervision, or operations from control rooms shall be constructed in a location remote from storage silos and headhouse structures as specified in 2-1.5.2 through 2-1.5.4.

Exception: This requirement shall not apply to small control rooms contiguous to specific operations such as railcar and truck discharging or loading or to control rooms such as those used in feed mills for mixing operations.

2-1.5.2 Such separate structures shall not be constructed directly over subterranean tunnels through which grain handling equipment or dust control system ductwork passes, or other tunnels that have direct openings into grain handling areas.

Exception: This requirement shall not apply to small control room structures contiguous to specific operations such as railcar and truck discharging or loading.

2-1.5.3 Where reinforced concrete is used in silos and headhouses, the separation distance from personnel-intensive areas shall be at least 100 ft (30 m).

2-1.5.3.1 Distances less than 100 ft (30 m) but in no case less than 50 ft (15 m) shall be permitted if:

- (a) The property boundaries or other permanent constraints preclude 100 ft (30 m), or
- (b) Structures do not have inside legs, or
- (c) Structures have inside legs that are equipped with explosion suppression systems in accordance with NFPA 69, *Standard on Explosion Prevention Systems*.

2-1.5.4 Where the headhouse is constructed of structural steel or reinforced concrete framework with lightweight, explosion-relieving wall panels, or does not contain inside or unprotected bucket elevators, the separation distance from personnel-intensive areas shall be at least 50 ft (15 m).

Exception: Distances less than 50 ft (15 m) shall be permitted if the property boundaries or other permanent constraints preclude 50 ft (15 m), but in no case shall distances less than 30 ft (9 m) be permitted.

2-2* Interior Surfaces. Horizontal surfaces shall be minimized to prevent accumulations of dust in all interior structural areas where significant dust accumulations could occur.

2-3 Interior Wall Construction.

2-3.1 Warehouse areas shall be cut off from production and other areas with fire barrier walls designed for a minimum fire resistance of 2 hr. For the purposes of this requirement, warehouses can include packaging, bagging, palletizing, associated operations, and pelleting systems.

Where automatic sprinklers are provided on both sides of the fire barrier wall to protect warehouse areas, production areas, and other areas, the fire barrier wall to separate warehouse areas shall be designed for a minimum fire resistance of 1 hr.

Exception: A fire barrier wall is not required for warehouses of 5000 ft² (m²) or less.

2-3.2 Necessary openings in fire partitions and fire walls shall be kept to a minimum and as small as practicable. Such openings shall be protected with listed self-closing fire doors, fire shutters, fire dampers, or penetration seals installed in accordance with NFPA 80, *Standard for Fire Doors and Fire Windows*.

2-3.2.1 Fire doors, fire shutters, fire dampers, and fire penetration seals shall be listed and shall have a fire resistance rating complying with NFPA 101®, *Life Safety Code*®.

2-3.2.2 Hold-open devices, if used, shall be listed and shall activate and allow the door to close upon sensing at least one of the following: heat, smoke, flames, or products of combustion.

2-4 Means of Egress.

2-4.1 Means of egress shall comply with appropriate chapters of NFPA 101, *Life Safety Code*.

2-4.1.1 All subterranean tunnels and passageways 50 ft (15 m) or longer shall have two means of egress as remote from each other as possible.

2-4.1.2 Roofs and bin decks shall have two means of egress that are remote from each other such that a single fire or explosion event will not likely block both means of egress.

Exception: Only one means of egress shall be required for roof areas where travel distance to the means of egress is less than 50 ft (15 m).

2-4.2 Interior stairs, elevators, and manlifts installed between floors constructed as firestops shall be enclosed in noncombustible shafts having a 1 hr or greater fire resistance rating.

Exception: Stairs, elevators, and manlifts serving only open-deck floors, mezzanines, and platforms need not be enclosed.

2-5 Bins, Tanks, and Silos.

2-5.1 Construction of bins, tanks, and silos shall conform to applicable local, state, or national codes.

2-5.2* Insofar as is practicable, silo walls and roofs shall be designed so that explosion relief vents, if provided, will open due to explosion overpressure before the silo walls fail.

Exception No. 1: This venting shall not be required if the silo is protected by an explosion suppression system or designed for containment in accordance with NFPA 69, Standard on Explosion Prevention Systems.

Exception No. 2: This does not apply to small bins such as process, surge bins, scales and their garners, or shipping bins.

2-5.3 Access doors or openings shall be provided to permit inspection, cleaning, and maintenance and to allow effective use of fire-fighting techniques in the event of fire within the bin, tank, or silo. Access doors or openings shall be designed to prevent dust leaks.

2-5.4 Where a bin, tank, or silo has a personnel access opening provided in the roof or cover, the smallest dimension of the opening shall be at least 24 in. (61 cm).

2-6 Marine Towers.

2-6.1 Marine towers shall be constructed of noncombustible materials.

2-6.2 Movable marine towers shall be provided with automatic or manually operated brakes.

2-6.2.1 Movable marine towers shall be provided with automatic or manual rail clamps.

2-6.2.2 Equipment to monitor wind velocity shall be installed on movable marine towers.

2-6.2.3 Rail clamps shall operate or be activated when the wind velocity is great enough to cause movement of the tower, even when brakes or gear drives are preventing the rail wheels from turning.

2-6.3 Movable marine towers shall have provisions for emergency tie-downs.

2-6.4 Marine (dock) spouting shall have safety devices to prevent spouts from falling if the operating cable(s) breaks.

Chapter 3 Ventilation and Venting

3-1 General.

3-1.1 In this chapter, ventilation refers to natural or mechanical movement of air necessary for normal operation and personnel comfort and safety.

NOTE: Chapters 4, 8, and 9 provide specific requirements for explosion relief and venting, dust control, and pneumatic conveying, respectively.

3-1.2 Recirculating or recycling exhaust air ventilation systems for dust explosion hazard areas, if used, shall be equipped with a filter systems capable of removing dust from the air.

3-1.3 Dust collection systems used in conjunction with ventilation systems shall comply with the provisions of Chapter 8 of this standard.

3-2 Venting of Bins, Tanks, and Silos.

3-2.1 Each bin, tank, or silo shall be provided with means for: air displacement during filling or emptying, with dust collection, or shall be vented to the outside.

3-2.2* Vents shall be designed to prevent plugging due to accumulations of dust.

3-2.3 Inclined vent stacks shall have clean-out doors or panels.

3-2.4 All vents shall be fitted with weather hoods.

3-2.5 Bin vents shall be sized to handle the air displaced by either filling or emptying.

Chapter 4 Explosion Prevention, Relief, and Venting

4-1 General. Explosion prevention, relief, and venting, as used in this standard, is intended to encompass the design and installation of devices and systems to vent the gases and overpressure resulting from a combustion explosion occurring in equipment, rooms, buildings, or other enclosures so that damage is minimized.

4-2* Requirements for Enclosures.

4-2.1* If a dust explosion hazard exists in rooms, buildings, or other enclosures, such areas shall be provided with explosion relief venting distributed over the exterior walls (and roof, if applicable). These are locations (1) in which combustible dust is in the air under normal operating conditions in quantities sufficient to produce explosive or ignitable mixtures; or (2) where mechanical failure or abnormal operation of machinery or equipment might cause such explosive or ignitable mixtures to be produced, and might also provide a source of ignition through simultaneous failure of electrical equipment, operation of protection devices, or from other causes. The design of such explosion relief venting shall consider the limitations imposed by the structural design of the area and shall offer the least possible resistance to explosion pressures.

Exception No. 1: Tunnels and pits where explosion venting is not practical due to confinement by soil, building constraints, or both.

Exception No. 2: Bins and silos where explosion venting is not practical due to bin or silo geometry, building constraints, or both.

4-2.2* Explosion relief panels, windows, or other venting devices shall be designed to prevent reclosing after relieving the explosion pressure and shall be attached to retention cables or restrained by equivalent means such that they will not become a hazardous projectile upon relief.

4-3 Requirements for Equipment.

4-3.1 Equipment requiring explosion prevention shall be protected by containment, suppression, inerting, or explosion venting.

4-3.2 Suppression, containment, or inerting systems shall be designed according to NFPA 69, *Standard on Explosion Prevention Systems*.

4-3.3* Venting shall be directed to a safe, outside location away from platforms, means of egress, or other potentially occupied areas.

Chapter 5 Equipment

5-1 Bearings.

5-1.1 Antifriction bearings shall be used on all machinery, conveyors, legs, and processing equipment.

Exception: Sleeve and friction-type bearings, plastic bearings, or oil impregnated wood bearings shall be permitted for equipment operating at 150 rpm or less.

5-1.2 All bearings shall be properly maintained per manufacturers' recommendations and shall be kept free of dust, product, and excessive lubricant.

5-1.3* All bearings on legs and conveyors shall be located outside of machinery enclosures and isolated from the product stream to minimize exposure to dust and to be more accessible for inspection and service.

Exception: Antifriction support bearings on screw conveyors and similar equipment requiring bearings to be within the product stream shall be of the sealed type. Sleeve and friction-type bearings shall be permitted for equipment operating at 150 rpm or less.

5-2 Drive Belts.

5-2.1 Where drive assemblies involve the use of belts, such as V-belts, timing belts, flat belts, etc., they shall be electrically conductive at 1 meg-ohm or less, and shall be fire resistant and oil resistant.

5-2.2 Where a drive belt is used, the drive train shall be designed with a minimum service factor of at least 1.5 and shall be designed to stall the drive with less than 3 percent slippage.

Exception: Line shaft drives as used in the milling industry.

5-3* Conveyors, Spouts, and Throws of Material.

5-3.1* Screw, drag, or en-masse conveyors shall be fully enclosed in metal housings and shall be designed to either relieve or stop if the discharge end becomes plugged.

5-3.2 Bulk material conveyor belts and lagging shall have a surface resistivity not greater than 100 meg-ohm per square, and shall be fire resistant and oil resistant.

5-3.3 Fixed spouts shall be dusttight.

5-3.4 Portable, automatic distributing, and movable spouts shall be permitted in work areas, bin areas, and distribution areas. Such spouts shall be as dusttight as practicable when in use.

5-3.5* Spouts that direct material into bins, tanks, or silos shall be designed and installed so that any foreign objects (such as metal or stones) in the material stream do not strike the walls of the container, as far as is practicable.

5-4 Bucket Elevators (Legs).

5-4.1 Legs Handling Bulk Raw Grain.

5-4.1.1 Legs shall be located outside of buildings.

Exception: As permitted in 5-4.1.3.

5-4.1.2* Exterior legs handling bulk raw grain shall be provided with explosion relief panels located at intervals no greater than 20 ft (6 m) along the vertical up and down side leg casings, and with the maximum explosion relief area practical in the head section.

5-4.1.3* Interior legs handling bulk raw grain shall be permitted if:

(a) Legs are located within 10 ft (3 m) of an exterior wall and are vented to the outside of the building, or

(b) Legs are provided with explosion protection as outlined in Section 4-3 (*see also A-5-4.1.2*), or

(c)* Legs have belt speeds below 500 ft/min (2.5 m/sec) or capacities less than 3750 ft³/hr (106 m³/hr).

5-4.2 All Legs.

Exception: The requirements in 5-4.2.1 through 5-4.2.4 and 5-4.2.12 shall not apply to legs handling inert material or other materials that do not present an explosion hazard.

5-4.2.1 Explosion venting of legs shall not be permitted into buildings.

5-4.2.2 Exterior legs shall be provided with explosion relief panels located at intervals no greater than 20 ft (6 m) along the vertical up and down side leg casings, and with the maximum explosion relief area practical in the head section.

5-4.2.3 Legs or portions of legs that are located inside shall have the maximum practicable explosion relief area through the roof directly to the outside.

Exception: Legs that have belt speeds below 500 ft/min (2.5 m/sec) or capacities less than 3750 ft³/hr (106 m³/hr).

5-4.2.4 Casing, head and boot sections, access openings, and connecting spouts shall be as dusttight as practicable and shall be constructed of noncombustible materials.

5-4.2.5* Boot sections shall be provided with openings for cleanout of the boot and for inspection of the alignment of the boot pulley and belt.

5-4.2.6 Inspection openings shall be provided in the head section to allow complete inspection of the head pulley lagging, the belt and pulley alignment, and the discharge throat of the leg.

5-4.2.7* Each leg shall be driven by an individual motor and drive train capable of handling the full-rated capacity of the elevator without overloading. The drive shall be capable of starting the unchoked leg under full (100 percent) load.

Exception: Line shaft drives as used in the milling industry.

5-4.2.8* Each leg shall be provided with a motion detector device that will cut off the power to the drive motor and actuate an alarm in the event the leg belt slows to 80 percent of normal operating speed. Feed to the elevator leg shall be stopped or diverted.

Exception: This requirement does not apply to legs that have belt speeds below 500 ft/min (2.5 m/sec) or capacities less than 3750 ft³/hr (106 m³/hr).

5-4.2.9* The use of plastic, rubber, and other combustible linings shall be limited to impact points, wear surfaces, and connected hoppers.

5-4.2.10 The leg head section between the up and down casings shall be sloped at an angle of not less than 45 degrees.

5-4.2.11 All spouts intended to receive grain or dry ingredients discharged directly from any leg shall be designed and installed to handle the full-rated elevating capacity of the largest leg feeding such spouts.

5-4.2.12 Legs shall have lagging installed on the head pulley to minimize slippage. Leg belts and lagging shall have a surface resistivity not greater than 100 meg-ohm per square and shall be fire resistant and oil resistant.

Exception No. 1: Oil resistance is not required for bucket elevators used in flour mills.

Exception No. 2: Line shaft drives as used in the milling industry are exempt from the lagging requirement.

5-4.2.13* Interior legs shall have bearing temperature or vibration detection, head pulley alignment, and belt alignment monitors at head and tail pulleys.

*Exception:** This requirement does not apply to legs that have belt speeds below 500 ft/min (2.5 m/sec) or capacities less than 3750 ft³/hr (106 m³/hr).

5-4.2.14 All garnerers, bins, or other receptacles into which material is spouted directly from legs, and which are not designed with automatic overflow systems, shall be equipped either with devices to shut down equipment or with high-level indicating devices with visual or audible alarms.

5-5 Processing Machinery and Equipment.

5-5.1* General.

5-5.1.1 Grain and bulk ingredient-receiving facilities shall be equipped with one or more devices such as grating, wire mesh screens, permanent magnets, listed electromagnets, pneumatic separators, or specific gravity separators.

5-5.1.2* Where tributary spouts or conveyors feed whole grain or grain products for size reduction into grinders, pulverizers, or rolling mills, they shall be equipped with properly installed permanent or listed electromagnets, pneumatic separators, specific gravity separators, scalpers, or screens to exclude metal or foreign matter of a size larger than the grain being processed as far as practicable.

5-5.1.3* Equipment shall be bonded and grounded to dissipate static electricity.

5-5.1.4 All processing machinery and components, such as magnets, shall be mounted to facilitate access for cleaning.

Exception: Where processing machinery is mounted on a tight-fitting base that prevents material from reaching inaccessible places beneath the machine, this requirement shall not apply.

5-5.1.5 Screw, drag, or en-masse conveyors shall be fully enclosed in metal housings and shall be designed to either relieve or stop if the discharge end becomes plugged.

5-5.2 Starch Processing Machinery and Equipment.

5-5.2.1 Carbon steel shall be avoided in the grinding chambers and moving parts of grinding mills in favor of brass, bronze, stainless steel, and other metals with lower sparking potential.

Exception: This does not apply to high-speed grinding Fitz mills.

5-5.2.2 Screens, scalpers, and similar devices shall have their reels or sieves in dusttight enclosures.

5-5.2.3 Connecting ducts shall be metal.

Exception No. 1: Nonmetallic flexible connecting ducts shall be permitted if they are electrically conductive, having an electrical resistance not greater than 1 meg-ohm.

Exception No. 2: Plastic tubing used for sample delivery systems shall be permitted.

5-5.2.4 Where more than one material source is connected to a common conveyor or collector, each source so connected shall be equipped with a rotary valve, choke seal, or other method to reduce the likelihood of propagation of an explosion in accordance with NFPA 69, *Standard on Explosion Prevention Systems*.

5-5.2.5 Dry milling or grinding of starch shall be performed in a separate building with explosion relief or in a separate room isolated from other areas by interior walls designed according to 2-1.2.

Exception No. 1: This requirement shall not apply if the equipment can be designed to be protected in accordance with NFPA 69, Standard on Explosion Prevention Systems, by deflagration containment, by explosion suppression, or by inerting the volume to reduce oxygen such that combustion is not supported.

Exception No. 2: This requirement shall not apply if mills are provided with explosion venting to a safe outside location. If explosion vent ducts longer than 10 ft (3 m) are to be used, the milling equipment and explosion vent duct shall be designed to withstand the increased vented explosion pressure.

Chapter 6 Dryers

6-1* Dryers. This chapter covers grain dryers, commodity product dryers, and starch dryers.

6-1.1 General. Dryers, within the scope of this standard, function to process materials that are subjected to heated air for the purpose of reducing their moisture content.

6-1.2* Other dryers used in further processing of agricultural commodities are outside the scope of this standard.

6-2* Grain Dryers.

6-2.1* Location.

6-2.1.1 Dryers shall be located so as to minimize fire exposure to adjacent buildings and structures, including other dryers, to minimize ignition potential to operating and storage areas, and to provide access for fire fighting.

6-2.1.2 Dryers shall not be located inside grain handling or grain storage structures.

6-2.2 Construction.

6-2.2.1 Dryers shall be constructed of noncombustible materials.

6-2.2.2 Dryers and related equipment shall be designed so that the fire hazard inherent in equipment operating at elevated temperatures is minimized.

6-2.2.3 Interior surfaces of dryers shall be designed to minimize the accumulation of material and to facilitate cleaning.

6-2.2.4 Dryers designed to recirculate a portion of the exhaust air shall have a means to minimize entrained particles from being reintroduced into the drying chamber.

6-2.2.5 Outward opening doors or openings shall be provided to allow access to all parts of the dryer and connecting spouts, inlet or outlet hoppers, and conveyors to permit inspection, cleaning, maintenance, and the effective use of portable extinguishers or hose streams.

6-2.2.6 Dryers shall be designed with means for unloading (emergency dumping) of the dryer contents to a safe outside location in case of fire. Such means shall provide for depositing the contents at a location and in a manner that does not cause fire exposure to adjacent buildings, structures, or equipment.

6-2.2.7 A method shall be provided for the safe handling of burning material and for the extinguishment of the burning material as it is emptied from the dryer.

6-2.3 Air Heating Systems.

6-2.3.1* The air heating systems shall include the heat source and associated piping or wiring, and the circulating fan and associated ductwork used to convey the heated air to the dryer.

6-2.3.2* The air heater and its components shall be properly selected for the intended application, shall be compatible with the types of fuels to be used, and shall be designed for the temperatures to which they will be subjected.

6-2.3.3 Direct-fired air heating systems shall have a means to minimize airborne combustible material from entering the drying chamber.

6-2.3.4 Burner systems and their controls for dryers fired by fuel oil, natural gas, mixed gas, manufactured gas, or liquefied petroleum gas, as well as mixing components, shall comply with NFPA 86, *Standard for Ovens and Furnaces*.

6-2.3.5 Liquefied petroleum gas vaporizing burner installations shall comply with NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*.

6-2.3.6 Fuel systems, up to the point of connection to the burner, shall comply with the following as applicable: NFPA 30, *Flammable and Combustible Liquids Code*; NFPA 31, *Standard for the Installation of Oil-Burning Equipment*; NFPA 54, *National Fuel Gas Code*; and NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*.

6-2.4 Safety Controls.

6-2.4.1 Safety controls shall be designed, constructed, and installed so that required conditions of safety for operation of the air heater, the dryer, and the ventilation equipment are maintained.

6-2.4.2 The dryer and its auxiliary equipment shall be equipped with excess temperature limit controls arranged to supervise the following:

- (a) The airstream between the fuel burner and the drying chamber air inlet, and
- (b) The airstream at the discharge of the cooling and heating sections.

6-2.4.3 Excessive temperatures detected by devices required by 6-2.4.2 shall initiate an automatic shutdown. The automatic shutdown shall:

- (a) Shut off the fuel or heat to the burners,
- (b) Stop flow of product out of the dryer,
- (c) Stop all airflow from fans into the dryer, and
- (d) Sound an alarm at a constantly attended location or for the operator, or both, to prompt an emergency response.

6-2.4.4 An emergency stop shall be provided that will enable manual initiation of the automatic shutdown required by 6-2.4.3.

6-2.4.5 All safety control equipment shall be nonrecycling and shall require manual reset before the dryer can be returned to operation.

6-2.5 Dryer Operation.

6-2.5.1 Operating controls shall be designed, constructed, and installed so that required conditions of safety for operation of the air heater, the dryer, and the ventilation equipment are maintained.

6-2.5.2 The drying chamber shall have an operating control that shall maintain the temperature within prescribed limits.

6-2.5.3 Extraneous material that is not normally part of the grain as it is received from the farm and that would contribute to a fire hazard shall be removed before it enters the dryer.

6-2.6 Fire Detection and Protection.

6-2.6.1 A fire-detection system shall be provided for the dryer when the operation is intermittent during the drying season and the dryer is shut down full or partially full of grain. Such detection system shall sound an alarm in a constantly attended location. The fire-detection system shall be permitted to be deactivated when the dryer has been thoroughly emptied and cleaned or when the dryer has been emptied, cleaned, and secured at the end of the drying season.

6-2.6.2 When operating practices prohibit the retention of any grain in the dryer during intermittent unattended shutdowns, a fire-detection system shall not be required.

6-2.6.3* Means shall be provided for extinguishing fires within the drying chamber.

6-3 Product Dryers.

6-3.1* Dryers and auxiliary equipment shall be designed, operated, cleaned, and maintained to minimize dust and product accumulation on inside surfaces.

6-3.2 Drying units shall be equipped with remote power cutoff switches.

6-3.3 On direct-fired dryers, the air supply shall be filtered of all particles that could be a combustion hazard.

6-3.4 Fuel systems, up to the point of connection to the dryer burner, shall comply with the following as applicable: NFPA 30, *Flammable and Combustible Liquids Code*; NFPA 31, *Standard for the Installation of Oil-Burning Equipment*; NFPA 54, *National Fuel Gas Code*; and NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*.

6-3.5 Direct-fired dryers with an explosion hazard located within buildings shall be protected in accordance with Section 4-3.

6-3.6 The combustion and burner system and controls shall be designed, operated, and tested as required in NFPA 86, *Standard for Ovens and Furnaces*.

6-4 Starch Dryers.

6-4.1 General. Starch dryers shall be designed and located in accordance with the requirements of 6-2.1 through 6-2.2.7.

6-4.2 Ignition Sources.

6-4.2.1* The interior heated surface of a starch dryer shall be designed and maintained to prevent the accumulation of starch that can attain a thickness or depth of 1/2 in. (13 mm) or more.

6-4.2.2 Inspection and clean-out doors shall be located at points in the system where spontaneous ignition is likely to occur, specifically where starch can build up and where starch is subject to continuous heat. Typical points include the following:

(a) Adjacent to steam coils that are subject to starch accumulation;

(b) In tubes or ducts of dryers where starch can accumulate (e.g., in elbows below a vertical run where entrained dust will fall when the fan is shut off, where there is a sharp change of direction from vertical to horizontal, and where there is a marked change to a lower velocity, such as a duct leading into a cyclone); and

(c) Near burners, to detect carbon buildup.

6-4.2.3 Inspection and cleaning of the above areas shall be performed to minimize starch accumulations.

6-4.2.4 The combustion and burner systems and controls shall be designed, operated, and tested as required in NFPA 86, *Standard for Ovens and Furnaces*.

6-4.3 Fire-Detection, Alarm, and Interlocking Systems.

6-4.3.1 Every dryer shall have the means for detecting abnormal conditions that indicate the presence or potential of a fire. The detection of these conditions shall activate an alarm and automatically shut down the equipment and activate the extinguishing system. The design of an automatically operated extinguishing system shall include provisions for the necessary personnel protective features required for inspection and cleaning of the dryers.

6-4.3.2 The dryer system, including auxiliary ducts, fans, and conveyors, shall be interlocked to provide a safe and orderly shutdown in the event of mechanical failure or abnormal operating conditions.

6-4.4 Suppression and Extinguishing Systems.

6-4.4.1* Each dryer located inside a building shall be protected by a permanently installed fire protection system, explosion suppression system, or both, in accordance with applicable NFPA standards. The system shall be actuated by fire or explosion detection devices that will sound an alarm and sequentially shut down the dryer. The fire extinguishing system shall be capable of manual actuation from locations that will be accessible during a fire in the dryer. The dryer shall not be returned to production until the fire protection or explosion suppression system has been restored.

6-4.4.2 Piping for extinguishing systems shall be located to minimize the possibility of destruction in case of an explosion.

6-4.4.3 The water supply for fire protection to buildings subject to explosion hazards shall be sectionalized in such a way that a water line break from an explosion can be readily isolated.

6-5* Inspection and Tests.

6-5.1 All fire-detection equipment shall be tested and maintained in accordance with NFPA 72, *National Fire Alarm Code*.

6-5.2 All fire extinguishing systems shall be tested and maintained in accordance with NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*.

6-5.3 A manufacturer's test and maintenance procedure shall be provided to the owner for testing and maintenance of explosion suppression systems in accordance with NFPA 69, *Standard on Explosion Prevention Systems*. This procedure shall provide for the initial testing of the equipment as well as for periodic inspection and maintenance.

Chapter 7 Heat Transfer Operations

7-1 Heat Transfer Systems.

7-1.1 Heat transfer devices utilizing air, steam, or vapors of heat transfer fluids shall be provided with pressure-relief valves where necessary. Relief valves on systems employing combustible heat transfer media shall be vented to a safe outside location.

7-1.2 Heaters and pumps for combustible heat transfer fluids shall be located in a separate, dust-free room or building of noncombustible construction and shall be protected by automatic sprinklers designed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*, to control a fire involving the combustible heat transfer fluid. Air for combustion shall be taken from a clean outside source.

7-1.2.1* Buildings or rooms that contain heat transfer equipment and boilers that use combustible heat transfer fluids shall be located in separate areas such that they do not communicate directly with areas that contain a dust explosion hazard.

7-1.2.2 Where combustible heat transfer fluids are used, doorways shall be curbed or ramped, and floor drains shall be provided to direct spills of the heat transfer fluid to a safe location. Automatic sprinkler protection designed to control these fluid fires shall be provided in areas containing equipment that uses these fluids and in areas containing storage tanks for these fluids.

7-1.3 Enclosures for heat exchangers shall be constructed of noncombustible materials and shall have access openings for cleaning and maintenance.

7-1.4* Heat exchangers shall be located and arranged in a manner that does not allow combustible dust to accumulate on coils, fins, or other heated surfaces.

7-1.5 Heaters for heat transfer systems shall be provided with operating controls. (See NFPA 86, *Standard for Ovens and Furnaces*.)

7-2 Comfort Heating.

7-2.1 In areas containing combustible dust, comfort heating, if provided, shall be done by a means designed to prevent ignition of dust clouds or layers.

7-2.2 Boilers used to provide hot water or low-pressure steam for comfort heating shall be located in a nonhazardous area and shall be installed in accordance with the requirements of 7-1.2.

7-2.3 Steam or hot water supply pipes and hot air supply ducts to comfort areas shall be fitted with insulation having a continuous, nonporous covering, and having an insulation quality sufficient to keep the temperatures of the outer surface below 140°F (60°C) for personnel safety purposes and less than 250°F (121°C) for prevention of dust ignition.

Chapter 8 Dust Control

8-1 Removal of Layered Agricultural Dust.

8-1.1 Dust on floors, structural members, and other surfaces shall be removed concurrently with operations.

8-1.2 The use of compressed air or other means that cause dust to be suspended in air during removal from ledges, walls, and other surfaces shall be permitted only after all machinery in the area has been shut down and all sources of ignition controlled.

Exception: Areas in processing facilities shall be permitted to be cleaned with compressed air, provided the following conditions are met:

(a) Airborne material will not envelop adjacent operating equipment; and

(b) Prior to blowdown, areas and adjacent equipment are checked to ensure that no ignition sources are present.

8-1.3* Portable electric vacuum cleaners, if used, shall be listed for use in Class II, Group G, Division I atmospheres as defined in NFPA 70, *National Electrical Code*. (See also 8-3.1.)

8-2 Dust Emissions.

8-2.1* A method shall be used to prevent the escape of dust from process equipment into the surrounding environment. Suppressants shall be permitted to be used for dust control.

8-2.1.1 In grain elevators, a method to prevent the escape of dust into surrounding areas shall be provided at leg boot sections, belt loaders, belt discharge or transfer points, trippers, turnheads, or distributors, and on unfiltered vents from which dust could be emitted into interior areas with displaced air.

8-2.1.2 Packaging and weighing systems, including fixed scale hoppers and upper and lower bins and garners, shall be enclosed and, if necessary, equipped with a venting system or air aspiration to collect the dust normally emitted by rapid air displacement during filling and emptying.

8-2.1.3 All machinery such as cleaners, scalpers, and similar devices normally used inside structures, but not designed to be dusttight, shall be provided with a means of controlling combustible dusts, if present.

8-2.2* Collected grain dust shall be permitted to be returned to the grain stream prior to or after being handled in a leg. Dust alone shall not be added directly to the leg and handled by itself. However, dust shall be permitted to be handled in an outside located leg that is used as part of a dust loadout system.

8-2.3 Dust returned to handling equipment other than a leg, storage, or process shall be returned such that it will not create dust emissions and shall be returned downstream of the collection point.

8-3* Dust Collection Systems.

8-3.1* Fans and blowers designed to convey combustible dusts through them shall be of spark-resistant construction and shall comply with all requirements of NFPA 91, *Standard for Exhaust Systems for Air Conveying of Materials*. Filter media dust collectors shall have a monitoring device (such as a differential pressure gauge) to indicate pressure drop across the filter media.

8-3.2 Dust collectors shall be located outside of buildings.

*Exception No. 1:** Dust collectors shall be permitted inside of buildings if located adjacent to an exterior wall and vented to the outside through straight ducts not exceeding 10 ft (3 m) in length, and designed so that the explosion pressures will not rupture the ductwork or the collector.

Exception No. 2: Dust collectors shall be permitted to be located inside of buildings if equipped with an explosion suppression system designed according to NFPA 69, *Standard on Explosion Prevention Systems*.

Exception No. 3: Centrifugal separators, without bags, used for removing moisture from coolers handling pelleted, extruded, or flaked grain and feed products shall be permitted inside buildings.

Exception No. 4: Bin vent dust collectors directly mounted without a hopper on a tank or bin, whose primary function is to filter air displaced during filling or blending operations and return dust directly to the bin, shall be permitted inside of buildings. Filters that return air to inside of buildings shall be capable of a minimum efficiency of 99.9 percent at 10 microns.

Exception No. 5: Filters used for classifying food products with air (product purifiers) shall be permitted to be located inside of buildings without explosion venting.

8-3.3 All components of the dust collection system shall be constructed of noncombustible materials.

Exception: Filter bags, filter media, liners, drive belts, wear parts, and flexible connector ducts.

8-3.4 Dust collection systems for one or more hammer mills or pulverizer mills shall not be manifolded with other types of machinery.

Exception: Conveyors, sifters, and hammer mills used for the sizing of oilseed meals and hulls shall be permitted to have a common dust collection system.

8-3.5* There shall be a separate dust collection system for each department in starch manufacturing and handling (i.e., starch drying, grinding, dextrine cooking).

8-3.6* Liberation of dust into the ambient air within a shed or structure from open pits or hoppers, such as truck or railcar dump pits, shall be reduced as much as practical by dust control.

8-3.7 Dust collection systems shall be in operation before startup of related machinery. Shutdown of a dust collection system collecting only combustible dusts shall actuate an audible or visual signal. Procedures shall be established or an automatic sequence provided to shut down related equipment if the dust collection system shuts down during operations.

8-3.8* Filtered Air.

8-3.8.1 Recycling of air from collectors to buildings shall be permitted if the system is designed to prevent both a return of dust and transmission of energy from a fire or explosion to the building. (For bin vents, see 8-3.2, *Exception No. 4*.)

8-3.8.2 Filters that return air to inside of buildings shall be capable of a minimum efficiency of 99.9 percent at 10 microns.

8-3.9* Bins and tanks for the storage of grain dust shall be dusttight, be constructed of noncombustible materials, be located external to the buildings or structures, and be equipped with explosion venting.

8-3.10* Floor sweeps shall not be operated as part of a dust collection system.

Chapter 9 Pneumatic Conveying

(See Appendix E for installation schematics depicting typical pneumatic conveying installation concepts.)

9-1* General. Pneumatic conveying, as defined for this chapter, consists of an enclosed tubing or piping system in which a raw material, an intermediate processed commodity, or a finished product is conveyed from one point to another with a stream of air or other gases.

9-2 General Design.

9-2.1* All system components shall be electrically conductive. Bonding and grounding shall be provided for all components including sight glasses and couplings.

9-2.2 Electrical wiring and power equipment shall meet all applicable requirements of NFPA 70, *National Electrical Code*.

9-3 Piping, Valves, and Blowers.

9-3.1 Positive- and negative-type pressure systems shall be permitted. Where the blower discharge pressure and its conveying system are designed to operate at pressures exceeding 15 psig (103 kPa), the system shall be designed in accordance with ASME *Unfired Pressure Vessel Code*, Section VIII.

9-3.2 All piping and tubing systems shall be supported to include the weight of material in a full or choked position, shall be airtight and dusttight, and shall be assembled in such a manner as to provide convenient disassembly for cleaning.

9-3.3 Pressure and vacuum-relief valves shall be located, designed, and set to relieve pressure to protect the system components.

9-3.4 Multiple-direction valves shall be of airtight and dusttight construction and sized to effect a positive diversion of the product with a full cross-sectional open area. Diversion in one direction shall seal all other directions from air, dust, or product leakage.

9-4 Air-Material Separators.

9-4.1 Air-material separators connected to processes that are potential sources of ignition such as hammermills, ovens, and direct-fired dryers, and other similar equipment shall be placed outside of buildings or structures or be protected in accordance with Section 4-3.

9-4.2* Filtered Air.

9-4.2.1 Recycling of air from air-material separators to buildings shall be permitted if the system is designed to

prevent both a return of dust and transmission of energy from a fire or explosion to the building. (For bin vents, see 8-3.2, *Exception No. 4*.)

9-4.2.2 Filters that return air to the inside of buildings shall be capable of a minimum efficiency of 99.9 percent at 10 microns.

9-4.2.3* Air from multiple pneumatic filters shall be permitted to be returned to the air make-up system. (See flow diagram in A-9-4.2.3.)

9-4.2.4* Air from hammermill filters shall not be returned to the air make-up system. (See flow diagram in A-9-4.2.4.)

9-4.2.5* Air from filters used for classifying food products (purifiers) shall be permitted to be returned to the air make-up system. (See flow diagram in A-9-4.2.5.)

9-4.3 Air from a multiple pneumatic conveying system, negative or positive, shall be permitted to be returned to the air make-up system.

9-5 Receiving and Shipping Conveyances.

9-5.1* All transport modes such as railcars (hopper car, boxcar, or tank car) and trucks (both receiving and shipping in bulk), into which or from which commodities or products are pneumatically conveyed, shall be electrically bonded to the plant ground system or earth grounded.

Exception: Materials of processes involving inert materials, such as limestone at feed mills, are exempt from these requirements.

9-5.2* Flexible connections shall be electrically conductive, having a resistance not greater than 1 meg-ohm. All connections between the transport vehicles and the plant system shall be made on the outside of the building.

Chapter 10 Building Fire Protection

(See Appendix B for supplementary information on fire protection.)

10-1* Portable Fire Extinguishers. Portable fire extinguishers shall comply with NFPA 10, *Standard for Portable Fire Extinguishers*.

10-2 Automatic Sprinklers. Where installed, automatic sprinklers shall comply with NFPA 13, *Standard for the Installation of Sprinkler Systems*.

10-3 Supervisory Services. Where installed, supervisory services shall comply with NFPA 72, *National Fire Alarm Code*.

10-4 Standpipe and Hose.

10-4.1 Standpipes and hoses, where installed, shall comply with NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*.

10-4.2 Wet or dry standpipes shall be provided to all operating levels over 75 ft (23 m) above grade.

10-4.3* Wet or dry standpipes shall be installed in warehouses and packing areas with combustible contents.

Exception: This requirement shall not apply to bulk storage warehouses or warehouses used for other than agricultural or food product storage.

10-5 Emergency Preplanning.

10-5.1 Each facility shall have a written emergency action plan that includes, but is not limited to, the following:

- (a) A means of notification for occupants in the event of fire and explosion;
- (b) A preplanned evacuation assembly area;
- (c) A person(s) designated to notify emergency responders, including fire department;
- (d) A facility layout drawing(s) showing egress routes, hazardous chemical locations, and fire protection equipment;
- (e) Location of a material safety data sheet(s) for hazardous chemicals;
- (f) An emergency telephone number(s); and
- (g) Emergency response duties for occupants.

10-5.2 Training shall be provided regarding the emergency action plan for all affected personnel.

10-5.3 The emergency action plan shall be coordinated with local emergency responders and shall include fire department prefire plans.

10-6 Fire-Fighting Operations.

10-6.1 Fires, when discovered, shall be reported promptly to facility management and emergency responders, including the fire department.

10-6.2* If possible, incipient fires shall be manually extinguished or burning materials removed. Burning materials shall not be transferred into logs.

10-6.3 If a fire cannot be controlled promptly in its incipient stage, the endangered structure(s) shall be evacuated.

10-6.4 Bearing fires shall be extinguished with a gentle application of water fog onto the bearing for cooling. If water is not available, other means of extinguishment shall be permitted to be used, provided caution is taken to avoid the suspension of combustible dust. If the bearing is located inside equipment, material flow shall be stopped and equipment shall be shut down. Extreme caution shall be used when equipment is opened.

Chapter 11 Supplemental Requirements

11-1 Electrical Wiring and Equipment.

11-1.1 Electrical wiring and equipment shall meet all applicable requirements of NFPA 70, *National Electrical Code*.

11-1.2* Electrical wiring and equipment in areas meeting the definition of Class II, Group G, Division 1 or 2 according to Article 500 of NFPA 70, *National Electrical Code*, shall comply with Article 502 of that code.

Exception No. 1: Electrical equipment that has been listed and installed as intrinsically safe according to NFPA 70, Article 504.

Exception No. 2: Electrical equipment that is housed in an enclosure that meets the applicable requirements of NFPA 496, Standard for Purged and Pressurized Enclosures for Electrical Equipment.

11-2 Hot Work.

11-2.1* Hot work operations in facilities covered by this standard shall comply with the requirements of NFPA 51B, *Standard for Fire Prevention in Use of Cutting and Welding Processes*.

11-2.2 Hot work shall be permitted only in safe, designated areas and shall not be permitted on equipment that is operating.

11-2.3 If it is necessary to cut or weld outside of safe, designated areas, the following precautions shall be followed:

11-2.3.1* A hot work permit system shall be used.

11-2.3.2 The hot work permit system shall include the following conditions:

(a) The area within 35 ft (11 m) of the work shall be cleaned of combustible dust.

(b) Other combustibles within 35 ft (11 m) of the work shall be moved or protected with covers, guards, or shields.

(c) Combustible floors or equipment in or below the work area shall be wet down or covered with damp sand, metal shields, or fire-retardant blankets or tarps.

(d) All equipment shall be thoroughly cleaned of combustible material and oil residues and any exposed combustible linings shall be removed.

(e) Combustible dust or flammable vapor-producing machinery or operations in the area shall not be permitted to be operating during the work.

(f) Fire protection or detection systems, if provided, shall be in operation during the work unless the work is being performed on the system.

(g) Floor and wall openings within 35 ft (11 m) of the work shall be covered or closed, and all open spouts in the work area shall be sealed or plugged.

(h) A fire watch supplied with suitable portable extinguishers or a water hose shall be maintained during the work and for at least 60 min after the work is completed.

(i) The duration of the permit system shall not exceed one shift.

(j) Hot work shall not be permitted on equipment that is operating.

11-2.3.3 The person responsible for authorizing the hot work operations shall inspect the proposed work area to determine that the conditions of the permit system have been met. The responsible person shall designate such additional precautions as are deemed necessary and shall sign the permit to authorize the work.

11-2.4 The hot work operations shall be stopped if the conditions of the permit change.

11-2.5 Upon completion of the work and after a time suitable for cooling hot surfaces, the areas shall be restored to normal operation.

11-2.6 Fire protection or detection systems shall not be disabled unless the hot work could activate them. If so, such systems shall be restored to service promptly after the hot work task is completed.

11-2.7 Regular inspections of the work area shall be made to determine that no smoldering fires develop, and an additional inspection shall be performed prior to closing the area for the day or weekend.

11-3 Spark-Producing Portable Power Tools and Propellant-Actuated Tools.

11-3.1 Spark-producing portable power tools and propellant-actuated tools shall not be used where combustible dust is present.

11-3.2 When the use of the spark-producing tools becomes necessary, all dust-producing machinery in the area shall be shut down. All equipment, floors, and walls shall be carefully cleaned and all dust accumulations in the area removed.

11-3.3 After completion of the work requiring the use of propellant-actuated tools, a careful check shall be made to be sure that no cartridges or powder charges are left on the premises where they could enter equipment or otherwise be accidentally discharged.

11-4* Static Electricity. Static electricity shall be dissipated by using bonding and grounding.

11-5 Engine and Motor-Driven Equipment.

11-5.1 Engine and motor-driven equipment used in confined Class II, Group G, Division 2 operating areas shall be equipped with safety devices designed to reduce the potential fire hazard and electrical shock hazard.

11-5.2* Engine and motor-driven equipment shall meet the requirements of NFPA 505, *Fire Safety Standard for Powered Industrial Trucks Including Type Designations, Areas of Use, Maintenance, and Operation*.

Exception: Front-end loaders or similar equipment used in flat storage areas or marine vessels to handle grain, meal, hulls, or other agricultural commodities.

11-5.3 Spark arresters shall be used on the exhaust stacks of all diesel-powered units.

Exception No. 1: Engines equipped with turbo-chargers.

Exception No. 2: Road vehicles, such as grain delivery vehicles, locomotives, and other vehicles that do not operate in combustible dust-producing areas.

11-5.4* Refueling shall be conducted outdoors.

11-5.5* Surface dust shall be removed from engine and motor-driven equipment at regular intervals during operation.

11-5.5.1 Cleaning of front-end loaders or other motor-driven equipment with compressed air shall not be conducted in hazardous locations.

11-5.5.2 Spark arresters shall be cleaned or replaced according to the manufacturer's recommendations.

11-5.6 Maintenance procedures shall comply with the manufacturer's instructions regarding replacement of insulation, covers, electrical enclosures, and parts of the electrical system designed to reduce chafing of insulation or termination failure.

11-6* Smoking. Smoking shall not be permitted.

Exception: In designated areas.

11-7 Storage of Oils, Flammable Liquids, and LP-Gas.

11-7.1 Flammable and combustible liquids shall be stored in closed containers, safety cans, flammable liquid cabinets, storage rooms, etc., as permitted in NFPA 30, *Flammable and Combustible Liquids Code*.

11-7.2* Portable LP-Gas cylinders shall be limited to a total of 300 lb (136 kg) and shall be stored in a designated area away from traffic and protected from direct sunlight. LP-Gas containers shall be stored so that the pressure relief valve is in direct communication with the vapor space of the container. (See NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*.)

11-8* Outside Contractors. Outside contractors performing work within the confines of the facility shall be instructed in applicable safety policies and procedures. These shall include, but are not limited to, hot work permits and prohibition of smoking in hazardous areas. The local facility manager shall establish a procedure for daily follow-up to ensure that the contractor is complying with established requirements.

11-9 Warning Signs. Where personnel are exposed to bodily risk from installed fire or explosion prevention systems, such as inert gas systems used to reduce oxygen concentration or explosion suppression systems, equipment and buildings having such systems shall be provided with warning signs. Warning signs shall indicate the potential dangers, shall state adequate precautions, and shall be posted at all entrances to the building or equipment.

11-10 Miscellaneous Storage in Grain-Handling Facilities.

11-10.1 There shall be no storage of sacks, nonessential uninstalled machinery or parts, or other supplies in areas where the only other combustible material is the agricultural commodity that is being stored.

11-10.2 Miscellaneous storage shall not impede facility housekeeping or fire fighting.

Chapter 12 Referenced Publications

12-1 The following documents or portions thereof are referenced within this standard and shall be considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

12-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 10, *Standard for Portable Fire Extinguishers*, 1994 edition.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 1994 edition.

NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, 1993 edition.

NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, 1995 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 1993 edition.

NFPA 31, *Standard for the Installation of Oil-Burning Equipment*, 1992 edition.

NFPA 36, *Standard for Solvent Extraction Plants*, 1993 edition.

NFPA 51B, *Standard for Fire Prevention in Use of Cutting and Welding Processes*, 1994 edition.

NFPA 54, *National Fuel Gas Code*, 1992 edition.

NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*, 1995 edition.

NFPA 69, *Standard on Explosion Prevention Systems*, 1992 edition.

NFPA 70, *National Electrical Code*, 1996 edition.

NFPA 72, *National Fire Alarm Code*, 1993 edition.

NFPA 80, *Standard for Fire Doors and Fire Windows*, 1995 edition.

NFPA 86, *Standard for Ovens and Furnaces*, 1995 edition.

NFPA 91, *Standard for Exhaust Systems for Air Conveying of Materials*, 1995 edition.

NFPA 101, *Life Safety Code*, 1994 edition.

NFPA 496, *Standard for Purged and Pressurized Enclosures for Electrical Equipment*, 1993 edition.

NFPA 505, *Fire Safety Standard for Powered Industrial Trucks Including Type Designations, Areas of Use, Maintenance, and Operation*, 1992 edition.

12-1.2 Other Publications.

12-1.2.1 ANSI Publication. American National Standards Institute, 11 West 42nd Street, New York, NY 10036.

ANSI/ISO 284:1982, *Conveyor belts — Electrical conductivity — Specification and method of test*.

12-1.2.2 ASME Publication. American Society of Mechanical Engineers, 345 East 47th Street, New York, NY 10017.

ASME *Unfired Pressure Vessel Code*, Section VIII, "Rules for Construction of Pressure Vessels," 1992.

12-1.2.3 U.S. Government Publication. U.S. Government Printing Office, Superintendent of Documents, Washington, DC 20402.

Code of Federal Regulations, Title 30, Part 18.65 (MSHA 2G Flame Test).

Appendix A Explanatory Material

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

A-1-1.1 Examples of facilities covered by this standard include, but are not limited to: bakeries, grain elevators, feed mills, flour mills, milling, corn milling (dry and wet), dry milk products, mix plants, soybean and other oilseed preparation operations, cereal processing, snack food processing, tortilla plants, chocolate processing, pet food processing, cake mix processing, and seed plants.

A-1-2.1 This standard is voluntary and follows the accredited NFPA practices. Public authorities with lawmaking or rule-making powers who are considering adoption of this standard should do so in a manner consistent with NFPA licensing provisions and should undertake an appropriate rule-making process consistent with the jurisdiction.

A-1-4 Agricultural Dust. Any time a combustible dust is processed or handled, a potential for explosion exists. The degree of explosion hazard will vary depending on the type of agricultural dust and processing methods used.

A dust explosion has four conditions, all of which have to be met:

- (a) The dust has to be combustible.

- (b) The dust particles have to form a cloud at or exceeding the minimum explosive concentration in air.

- (c) Confinement. The dust has to be confined within a piece of equipment, a building, or a structure.

- (d) A source of ignition has to be present.

Evaluation of a combustible dust explosion hazard and the prevention techniques employed should be determined by means of actual test data. All combustible dusts that can produce a dust explosion should be tested so as to determine the following data:

- (a) Particle size distribution,

- (b) Moisture content as received and dried,

- (c) Minimum dust concentration to ignite,

- (d) Minimum energy required for ignition (joules),

- (e) Maximum rate of pressure rise at various concentrations,

- (f) Layer ignition temperature, and

- (g) Maximum explosion pressure at optimum concentration.

Optional testing includes:

- (a) Dust cloud ignition temperature,

- (b) Maximum permissible oxygen content to prevent ignition, and

- (c) Electrical resistivity measurement.

A-1-4 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations that is in a position to determine compliance with appropriate standards for the current production of listed items.

A-1-4 Authority Having Jurisdiction. The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A-1-4 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A-2-1.1 Materials for construction should be noncombustible, as defined in NFPA 220, *Standard on Types of Building Construction*.

A-2-1.2 For information on designing to relieve explosion pressure, see NFPA 68, *Guide for Venting of Deflagrations*.

A-2-1.4 For the purpose of this standard, masonry construction refers to stone, brick, gypsum, hollow tile, concrete block, and cinder block building units, or other similar building units or materials laid up unit by unit and set in mortar.

A-2-2 The suggested minimum angle of repose of dust is 60 degrees. Vertical surfaces should be smooth to facilitate cleaning. Horizontal surfaces should be minimized to prevent accumulation of dust.

A-2-5.2 See NFPA 68, *Guide for Venting of Deflagrations*, for information on the design of explosion venting.

A-3-2.2 If a vertical vent stack cannot be installed because of structural conditions, the vent should be permitted to be located in the side of the bin, below its top, or should be permitted to be installed at an angle of up to 30 degrees from vertical.

A-4-2 See NFPA 68, *Guide for Venting of Deflagrations*, for information on the design of explosion venting.

A-4-2.1 Table A-4-2.1 contains 20-liter sphere test data for selected agricultural dusts with known explosion data parameters to aid in the determination of the potential for a dust explosion hazard to be present in the enclosure.

Table A-4-2.1 20-Liter Sphere Test Data—Agricultural Dusts

Dust Name	P _{max} ¹ (bar _g)	K _{St} (bar m/s)	% moisture	% smaller than 200 mesh (75 microns)
Carrageen	8.5	140	3.8	98
Cocoa bean dust	7.5	152	n/a	n/a
Cocoa powder	7.3	128	n/a	n/a
Coconut shell dust	6.8	111	6.5	51
Cornstarch	7.8	163	11.2	0
Garlic powder	8.6	164	n/a	n/a
Locust bean gum	7.8	78	1.7	53
Onion powder	9.0	157	n/a	n/a
Parsley (dehydrated)	7.5	110	5.4	26
Rice dust	7.7	118	2.5	4
Semolina	7.6	79	0.0	9
Soybean dust	7.5	125	2.1	59
Spice powder	7.8	172	n/a	n/a
Sugar (10x)	8.4	154	n/a	n/a
Tobacco blend	8.8	124	6.9	55
Walnut dust	8.4	174	6.0	31
Wheat flour	9.0	139	12.9	6

NOTE 1: Normalized to 1 m³ test vessel pressures, per ASTM E 1226, *Standard Test Method for Pressure and Rate of Pressure Rise for Combustible Dusts*.

NOTE 2: See also Table E-1 in NFPA 68, *Guide for Venting of Deflagrations*, for additional information on agricultural dusts with known explosion hazards.

NOTE 3: For those agricultural dusts without known explosion data, the dust should be tested in accordance with ASTM E 1226, *Standard Test Method for Pressure and Rate of Pressure Rise for Combustible Dusts*.

A-4-2.2 If an explosion vent recloses after relieving an explosion pressure wave, an implosion can occur.

A-4-3.3 See NFPA 68, *Guide for Venting of Deflagrations*, for information on determining the appropriate explosion

venting area and arrangement. For information on venting bucket elevators, see the National Grain and Feed Association Research report, *Emergency Preplanning and Fire Fighting Manual — A Guide for Grain Elevator Operators and Fire Department Officials*.

A-5-1.3 Pillow block bearings are preferred for head, tail, and bend pulleys.

A-5-3 Throwing of grain for a considerable distance (i.e., not confined in spouts) should not be permitted unless absolutely necessary in open or semiconfined spaces, such as in barge and ship loading or in large bulk grain storage areas.

A-5-3.1 Each bulk material conveyor should be provided with a motion detector device that will cut off the power to the drive motor and actuate an alarm in the event of slow-downs at no more than 20 percent. Feed to the bulk material conveyors should be stopped or diverted.

A-5-3.5 Spout openings in distributors and turnheads should be closed when not in use to reduce the likelihood of propagation of flame through idle spouts.

A-5-4.1.2 Explosion relief vents on outside bucket elevators should be distributed along the leg casing by providing explosion vents opposite each other on the up and the down side of the leg casing, located on the casing side next to the ends of the buckets. Each explosion vent should be a minimum of two-thirds of the cross-sectional area of the leg casing and should be located on every other casing section [approximately 20 ft (6 m) apart]. Vents should be secured with explosion relief fasteners capable of releasing when an internal pressure of 0.5 psig to 1.0 psig (3.4 kPa to 6.9 kPa) occurs. Vents should be connected to the casing by a cable to prevent them from flying free during a release. Vent materials should be of lightweight construction and meet the guidelines given in NFPA 68, *Guide for Venting of Deflagrations*.

Bucket elevator head sections are recommended to have 5 ft² (0.5 m²) of vent area for each 100 ft³ (2.8 m³) of head section volume. Vents should not be directed at work platforms, building openings, or other potentially occupied areas.

For many leg configurations, explosion venting should be made in the top of the head section to avoid exposing personnel on maintenance platforms. If the recommended venting areas cannot be achieved, some venting is better than none, since it can greatly reduce explosive pressures and damage.

A-5-4.1.3 Interior legs located in concrete leg wells should be avoided.

Where venting is provided for an inside bucket elevator, explosion vents should be directed to outside areas following the guidelines of NFPA 68, *Guide for Venting of Deflagrations*, and distributing leg vents along the leg as recommended above. Vents should never be directed to the inside of a structure.

It is preferable to locate inside legs that are to be vented next to outside walls to minimize the length of explosion relief ducts.

Explosion suppression devices can be used in conjunction with leg feed and discharge points to limit flame propagation into structures or other grain-handling equipment.

A-5-4.1.3(c) The exemption for 3750 ft³/hr (106 m³/hr) represents a processing rate of 3000 bushels/hr. This exemption is based on no reported industry losses.

A-5-4.2.3 Exception. The exemption for 3750 ft³/hr (106 m³/hr) represents a processing rate of 3000 bushels/hr. This exemption is based on no reported industry losses.

A-5-4.2.5 Access doors should be dusttight. Pits should be lighted and accessible and should provide ample room for cleaning, lubrication, repairs, and replacement of parts. Elevator boot sections and the spouts feeding them should be constructed so as to minimize choking of the boot.

A-5-4.2.7 The motor selected should not be larger than the smallest standard motor capable of meeting this requirement.

A-5-4.2.8 Belt alignment monitoring devices are recommended for all elevator legs. Bearing monitoring systems are recommended for head, tail, and bend (knee) pulley bearings on elevator legs.

A-5-4.2.9 Noncombustible linings should be used whenever practical.

A-5-4.2.13 This requirement is also desirable for outside legs.

A-5-4.2.13 Exception. The exemption for 3750 ft³/hr (106 m³/hr) represents a processing rate of 3000 bushels/hr. This exemption is based on no reported industry losses.

A-5-5.1 Openings of 2½ in. × 2½ in. (6.4 cm × 6.4 cm) should be used on grating for receiving pits to limit entry of foreign objects. Larger openings might be needed to accommodate some materials, such as whole corncobs and hay cubes.

A-5-5.1.2 Such devices should be installed on hoppers, conveyors, or spouts handling grain from truck dump pits, railcar dump pits, and barge or ship unloading systems prior to entry of the grain into subsequent conveyors, elevators, or processing machinery to minimize the entry of tramp metal and other foreign objects.

A-5-5.1.3 NFPA 77, *Recommended Practice on Static Electricity*, provides information on this subject.

A-6-1 Static deposits of combustible dust on heated surfaces are subject to ignition due to carbonization of the dust. Understanding of the mechanism involved is lacking, but it does appear that there is no direct relationship between the temperature necessary to ignite a dust cloud and that necessary to ignite a dust layer. Rather, a time-versus-energy (temperature) relationship appears to be involved. The higher the temperature, the shorter the time needed for carbonization and subsequent ignition.

The energy necessary to ignite a dust cloud must be great enough to raise the dust particles to their ignition temperature and overcome heat losses to the surrounding air. The energy must also be of sufficient duration to ignite enough adjacent dust particles to sustain propagation of the flame front. A static dust deposit has none of the dynamic motion and heat losses of a dust cloud. Also, the insulating characteristics of organic dusts act to retard the heat loss from particles of dust in intimate contact with the heated surface. Thus, a lower temperature is necessary to establish the time-energy relationship leading to ignition. This behavior, combined with the fact that the ignition temperature of an organic dust is lowered by prolonged heat exposure, gives cause for concern over dust deposits on heated surfaces. The ignition of a dust layer and the

subsequent quiescent burning can provide the pilot flame necessary to ignite a dust cloud.

A-6-1.2 For information on other dryers, see NFPA 86, *Standard for Ovens and Furnaces*.

A-6-2 Typically, a grain dryer is a self-contained unit that processes bulk quantities of an agricultural commodity either by continuous flow or in batch quantities. The dryer is usually located on the plant property, adjacent to the elevator, storage building, or tank. The commodity, either directly from harvest or from interim storage, contains extraneous materials, partly as a result of harvesting, that have a tendency to interfere with the drying process and to contribute to fires within the dryer itself.

A-6-2.1 Particular attention is needed when adjacent buildings or structures are of combustible construction or have walls with vents, windows, or spout or conveyor openings.

A-6-2.3.1 The dryer can be direct fuel-fired (i.e., the products of combustion enter the drying chamber) or indirect fuel-fired (i.e., the products of combustion do not enter the drying chamber).

A-6-2.3.2 Typically, the firing rates of grain dryers are on a demand basis created by a temperature-measuring device located in the heated air stream prior to its contact with grain. The demand set point is chosen to produce the desired degree of dryness or moisture removal.

This control arrangement maintains the air temperature within the upper and lower temperature ranges of the measuring device. If the temperature range is exceeded, the burner firing rate is reduced and, when the temperature drops below the lower range, the burner firing rate is increased.

This control arrangement is satisfactory for most operating conditions, grain moisture content, and ambient temperature conditions. Operators usually recognize that, if the grain is unusually wet, they need to increase the dryer temperature setting and possibly slow down the rate of grain flow through the dryer. It has to be recognized that the burner needs to operate at abnormally high firing rates when the outside temperatures are unusually cold.

A-6-2.6.3 One or a combination of the following methods, depending on local conditions, should be used:

(a) Fixed water spray or automatic sprinkler systems with adequate water supplies (*see NFPA 13, Standard for the Installation of Sprinkler Systems, and NFPA 15, Standard for Water Spray Fixed Systems for Fire Protection*);

(b) 1½-in. (3.8-cm) hose lines of sufficient length to reach all access openings on the dryer, connected to a 2-in. (5.1-cm) or larger water supply line (*see NFPA 14, Standard for the Installation of Standpipe and Hose Systems*);

(c) Small-diameter hose lines of sufficient length to reach all access openings on the dryer and supplied by the domestic water system;

(d) Fixed water spray or automatic sprinkler systems supplied by a dry standpipe;

(e) An adequately designed steam smothering system; and

(f) Class A portable fire extinguishers.

A-6-3.1 Spontaneous ignition is a primary cause of dryer fires and explosions. The requisites of this phenomenon are a heated surface or a hot airstream, a layer of product exposed to this heat, and time.

A-6-4.2.1 Spontaneous ignition is a primary cause of dryer fires and explosions. The requisites of this phenomenon are a heated surface or a hot airstream, a layer of product exposed to this heat, and time. In the case of starch, a catalyst appears to be water from leaks or condensation. Fires have occurred in such accumulations at normal operating temperatures of 350°F (177°C). Thus, the control of these elements through design, operation, cleaning, and maintenance will prevent explosions from this ignition source.

A-6-4.4.1 Where an outside dryer is provided with adequate explosion venting, fire protection or explosion suppression systems might not be necessary.

A-6-5 Inspection. The entire fire extinguishing system should be completely inspected at least annually. More frequent general inspections are recommended. Regular service contracts with the manufacturer or installing company are recommended.

In the annual inspection, particular attention should be given to the detection and actuation system, containers, piping and nozzles, and auxiliary equipment.

(a) Inspection of Detection and Actuation System.

1. The detectors should be checked (and cleaned if necessary) to ensure that they are free of foreign substances.
2. If the detection system is supervised, the supervisory features should be checked to determine that the detection system is in satisfactory condition. The methods and procedures for this inspection should be according to the manufacturer's recommendations.

(b) Inspection of Containers.

1. Containers should be examined for evidence of corrosion or mechanical damage.
2. Container bracketing, supports, etc., should be checked to determine that their condition is satisfactory.

(c) Inspection of Piping and Nozzles.

1. Piping should be examined for any evidence of corrosion.
2. Pipe hangers or straps or both should be examined to see that the piping is securely supported.
3. Nozzles should be checked to determine that the orifices are clear and unobstructed.
4. Where nozzle seals are provided, they should be checked for signs of deterioration and replaced if necessary.
5. Nozzles should be checked for proper position and alignment.

(d) Inspection of Auxiliary Equipment.

1. All auxiliary and supplementary components such as switches, releases, interconnected valves, supplementary alarms, etc., should be manually operated (where possible) to ensure that they are in proper operating condition.
2. All devices should be returned to normal standby condition after testing.

A-7-1.2.1 Communication between hazardous and heat-producing areas should be arranged so that a fire partition, fire wall, etc., with all openings closed is always between the hazard and the heat-producing area. The fire break may be a nonhazardous room, entryway, airlock,

etc., arranged so that the communicating opening between the room and the hazardous area will not be open when the communicating opening between the room and heat-producing area is open, and vice versa.

A communicating opening such as machinery doors will be permitted, provided that these doors are kept locked and are only opened when either the hazardous area or the heat-producing area is shut down and will not cause a fire or explosion with the machinery door open.

A-7-1.4 Deposits of combustible dust on heated surfaces are subject to ignition due to carbonization of the dust. Understanding of the mechanism involved is lacking, but it does appear that there is no direct relationship between the temperature necessary to ignite a dust cloud and that necessary to ignite a dust layer. Rather, a time-versus-energy (temperature) relationship appears to be involved. The higher the temperature, the shorter the time needed for carbonization and subsequent ignition.

The energy necessary to ignite a dust cloud needs to be great enough to raise the dust particles to their ignition temperature and overcome heat losses to the surrounding air. The energy also needs to be of sufficient duration to ignite enough adjacent dust particles to sustain propagation of the flame front. A dust deposit has none of the dynamic motion and heat losses of a dust cloud. Also, the insulating characteristics of organic dusts act to retard the heat loss from particles of dust in intimate contact with the heated surface. Thus, a lower temperature is necessary to establish the time-energy relationship leading to ignition. This behavior, combined with the fact that the ignition temperature of an organic dust is lowered by prolonged heat exposure, gives cause for concern over dust deposits on heated surfaces. The ignition of a dust layer and the subsequent quiescent burning might provide the pilot flame necessary to ignite a dust cloud.

A-8-1.3 Vacuum cleaning systems are preferred for removal of static dust on surfaces in order to prevent re-suspension of the dust in ambient air, as is often caused by brushing down with brooms or using compressed air. Where the surfaces are inaccessible or create a hazard to employees working from stepladders or in hazardous positions while handling vacuum hoses and tools, alternative means should be followed under the conditions specified in 8-1.3.

A-8-2.1 Techniques to prevent or reduce dust generation and dispersal are vital to any dust control program. These include the use of reduced handling speeds, dead boxes, choked feeding, snorkel loaders, dusttight enclosures, short vertical runs, cleaning, and dust suppressant, as well as many others. Preventive dust control is encouraged, since it can effectively reduce total dust control costs as well as the demands placed on the performance of subsequent dust control techniques outlined in Sections 8-2 and 8-3.

Various oils and other liquids have been used as a dust suppressant. Each dust suppressant has its limitations and should be used with regard to applicable grain and food standards and regulations. Oil dust suppressants should not be applied directly into the leg, as there have been cases of belt slippage using oil. Application should be made in the transition spout between the receiving pit and the receiving leg. If this is not feasible, application can be made at a transfer point or discharge of a conveying system, or directly on a conveyor belt or into a screw auger. The idea

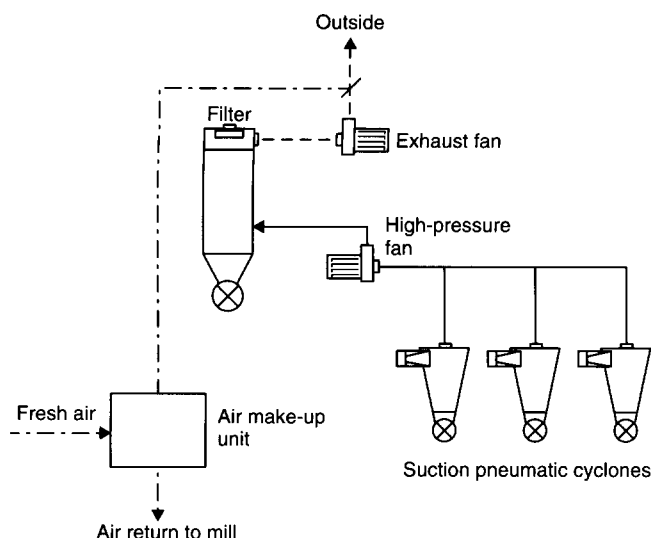


Figure A-9-4.2.3 Example of typical pneumatic filter cyclone illustration.

is to apply the dust suppressant where there is grain turbulence, thereby allowing the dust suppressant to mix thoroughly.

A-8-2.2 Legs are the most frequent location of known primary dust explosions and can experience malfunctions, which can result in ignition of the returned dust.

A-8-3 Information on dust collection systems can be found in NFPA 91, *Standard for Exhaust Systems for Air Conveying of Materials*.

A-8-3.1 Information on spark-resistant fans and blowers can be found in AMCA (Air Movement and Control Association) Standard No. 99-0401-91, Type A or B construction.

A-8-3.2 Exception No. 1. NFPA 68, *Guide for Venting of Deflagrations*, provides information on this subject.

A-8-3.5 Return air ducts should have a method to prevent excessive dust from returning to the plant in the case of filter failure. Methods include, but are not limited to, use of a diverter valve that exhausts return air outside, or a series of secondary filters in the return air line designed to collect the material if part of the filter media fails.

A-8-3.6 Dust control in grain or product-receiving areas consists of air aspiration or dust containment during vessel or vehicle unloading. Dust control can be achieved by baffles or enclosures with air aspiration, dust suppression, choked feeding, special belt designs, slowdown techniques, or other methods.

A-8-3.8 If the return air duct air-material separator fails, a control system should be provided to direct the return air to an auxiliary filter capable of effectively entraining the dust particles, or to produce an alarm and shut down the system.

A-8-3.9 NFPA 68, *Guide for Venting of Deflagrations*, contains guidance on designing explosion vents to relieve deflagrations of combustible dusts in vessels having length-to-diameter (L/D) ratios of 3 or less.

A-8-3.10 Floor sweeps, if used, should be designed and operated according to the provisions of NFPA 650, *Standard for Pneumatic Conveying Systems for Handling Combustible Materials*.

A-9-1 Pneumatic conveying for product transport is to be distinguished from dust collection systems that are designed to handle airborne dust. Such airborne dust systems might or

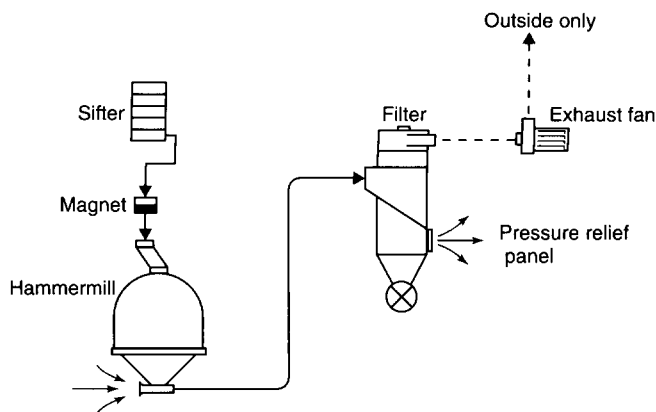


Figure A-9-4.2.4 Example of typical hammermill filter illustration.

might not be used in conjunction with pneumatic conveying and are covered in Chapter 8 of this standard. Other gases used in this process include carbon dioxide and nitrogen.

A-9-2.1 For guidance on static electricity, see NFPA 77, *Recommended Practice on Static Electricity*.

A-9-4.2 If the return air duct air-material separator fails, a control system should be provided to direct the return air to an auxiliary filter capable of effectively entraining the dust particles, or to produce an alarm and shut down the system.

A-9-4.2.3 Pneumatic Filters. Filters used for air from negative mill pneumatics using cyclones for product separation should be permitted to be located inside of buildings without explosion venting. Clean air should be partially returned to the air make-up system. (See Figure A-9-4.2.3)

A-9-4.2.4 Hammermills. Filters used for hammermills should be equipped with explosion venting. Clean air should not be returned to the air make-up system. (See Figure A-9-4.2.4.)

A-9-4.2.5 Product Purifiers. Filters used for product purifiers should be permitted to be located inside of buildings without explosion venting. All clean air should be returned to the air make-up system. (See Figure A-9-4.2.5.)

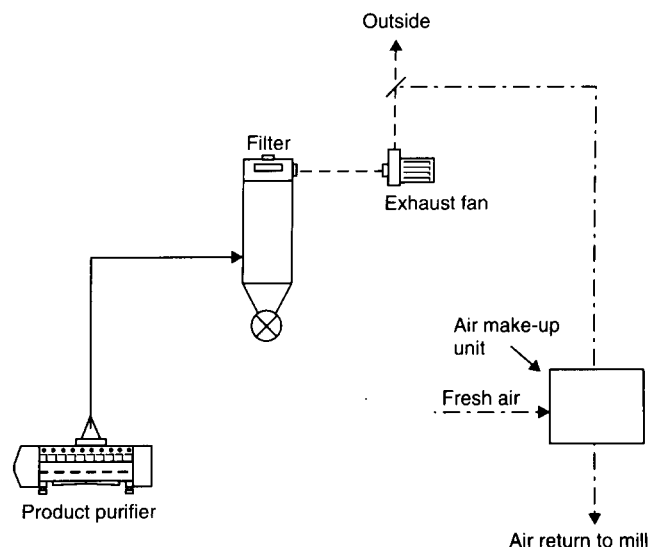


Figure A-9-4.2.5 Example of typical product purifier illustration.

A-9-5.1 See NFPA 650, *Standard for Pneumatic Conveying Systems for Handling Combustible Materials*.

A-9-5.2 Electrically flexible, conductive tubing.

A-10-1 Caution should be exercised in the selection of extinguishers for use on dusts; extinguishers with a high-pressure discharge might raise additional dust, resulting in further combustion or an explosion.

A-10-4.3 Examples of combustible contents are finished products and raw material in paper or cloth bags, cardboard boxes or containers, wood pallet storage, and packing material storage.

A-10-6.2 Incipient Fire-Fighting Techniques.

(a) *Leg Fires.* Material flow into a leg should be stopped and the leg should be shut down. Leg fires should be extinguished by water fog or gentle application of water. Fires should be located by feeling the leg casing for heat or observing discoloration of metal. If the location is unknown, water should be applied first in boot section, then in bin-pulley access door, and last in head section.

(b) *Conveyor Belt Fires.* Conveyor belt fires should be extinguished by application of water. Material flow to conveyor belt should be stopped. If necessary, the belt should be cut to isolate the fire.


(c) *Dryer Fires.* Dryer fires should be extinguished by removing burning material from the dryer or gentle application of water. Fuel to burners, fans, and material flow into the dryer and from the facility should be stopped. If necessary, emergency dump should be used to remove material from the dryer.

(d) *Concrete Bin or Silo and Steel Tank Fires.* Concrete bin or silo fires should be extinguished by removing burning material from the bin or silo directly to the outside after wetting the top surface of the material with gentle application of water at a low flow rate directly to the burning materials. Water fog should be applied to walls and to the underside of the roof to reduce airborne dust. Fire should be located by thermometer probes, thermographic photography, or feeling heat on bin or silo surfaces. Openings to bin or silo should be sealed to limit oxygen entry. Material flow to and from the bin or silo should be stopped. Fire-fighting operations should be done from outside the bin or silo. Fires should be isolated by selective unloading of material near the fire in steel tank.


(e) *Fumigant or Chemical Fires.* Fires involving fumigants containing phosphine should be extinguished by inert material or nonaqueous agent used for Class B fires. Water should not be used for phosphine fires to avoid exothermic reaction and development of explosive gases.

(f) *Water Gas Reaction.* Application of small amounts of water on glowing grain in a partially confined space, such as a grain silo, and in the presence of air, can generate a water gas reaction. The glowing grain must be at temperatures of at least 1290°F to 1470°F (700°C to 800°C), and initial water contact might not cool the mass of glowing grain below 1110°F (600°C).

The partial oxidation-reduction between carbon and water forms carbon monoxide and hydrogen:



In the presence of oxygen (air), the carbon monoxide and hydrogen burn, immediately releasing heat.



In a partially confined space, the combustion energy will rapidly pressurize the space beyond what the silo walls or tops can withstand, causing destruction of the silo.

A-11-1.2 NFPA 497B, *Recommended Practice for the Classification of Class II Hazardous (Classified) Locations for Electrical Installations in Chemical Process Areas*, contains guidelines for determining whether an area should be categorized as a Class II area or not.

A-11-2.1 OSHA 29 CFR, Part 1910.272, also establishes requirements for hot work in grain handling operations.

A-11-2.3.1 See permit form example in NFPA 51B, *Standard for Fire Prevention in Use of Cutting and Welding Processes*, Appendix A.

A-11-4 NFPA 77, *Recommended Practice on Static Electricity*, provides information on this subject.

A-11-5.2 Refer to the following publications for further information:

UL 558, *Standard for Internal Combustion Engine-Powered Industrial Trucks*.

UL 583, *Standard for Electric Battery Powered Industrial Trucks*.

(Factory Mutual) *Approval Standard for Gasoline or Diesel Engine-Powered Industrial Trucks, Types G, GS, D, or DS*.

(Factory Mutual) *Approval Standard for Electrical Battery Powered Industrial Trucks, Types E and EE*.

(Factory Mutual) *Approval Standard for LP-Gas Engine-Powered Industrial Trucks, Types LP and LPS*.

ANSI B56.1, *Safety Standard for Low Lift and High Lift Trucks*.

A-11-5.4 Exterior docks should open at least on one side, and exterior platform areas should be considered to meet the "outdoor" provision.

A-11-5.5 Cleaning should be done at 4-hr intervals during periods of steady operation and at the end of each workday.

A-11-6 "NO SMOKING" signs should be posted.

A-11-7.2 Preferred location is a rack located outside at least 10 ft (3 m) from combustible materials or walls and protected from direct sun. Chains might be necessary to protect against vandalism or theft.

A-11-8 Outside Contractors. Topics of the checklist should include, but should not be limited to:

(a) Hot work permits.

(b) Facility smoking regulations.

(c) Restriction of alcohol, drugs, weapons, etc., on the premises.

(d) Vehicle traffic control in plant (i.e., restricted areas, plant traffic pattern, railroad traffic), railroad car switching procedure, warning system, and restrictions on crossing tracks.

(e) Restricted access to nonworking areas and areas where additional safety instruction should be received before contractor is authorized to enter.

(f) Authorization before the cutting of any processing lines, or the opening or closing of any valve.

- (g) Shutdown of operating equipment by contractor.
- (h) Replacement of guards before restarting the equipment.
- (i) Housekeeping and sanitation responsibilities and requirements for end-of-day cleanup by contractor.
- (j) Accident reporting requirements (personnel injury and property damage).
- (k) Use and restrictions of passenger elevators and manlifts.
- (l) Familiarization with plant emergency organization and actions to be taken by contractor in an emergency situation.
- (m) Familiarization and instruction in use of all pertinent procedures.
- (n) Restricted use of tools and equipment by contractor.
- (o) Use of protective equipment by contractor personnel.
- (p) Use and storage of hazardous or flammable materials.
- (q) Use and storage of acetylene and oxygen cylinders.

Appendix B Supplementary Information on Fire Protection

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

B-1 Automatic Sprinklers. All areas containing combustible materials, except bulk storage tanks and bins, should be protected by suitable automatic sprinkler systems installed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*; NFPA 231, *Standard for General Storage*; and NFPA 231C, *Standard for Rack Storage of Materials*, as applicable.

B-2 Supervisory Services. For prompt detection of fires, either watchman service, an automatic fire-detection system, or sprinkler water flow and supervisory service should be provided. If watchman service is provided, routing and recording apparatus should meet the requirements of NFPA 601, *Standard on Guard Service in Fire Loss Prevention*. Automatic fire detection systems to actuate local alarms or other suitable arrangements for automatically notifying the fire department should meet the applicable requirements of NFPA 72, *National Fire Alarm Code*.

B-3 Hydrants. Either public or private hydrants should be provided for fire-fighting use. Hydrants should be fed by an adequate water supply.

B-4 Explosion Suppression. Explosion-suppression systems designed for instantaneous detection and suppression of explosions are available for use in confined areas such as bins, tanks, dust collectors, etc. The use of such systems should be considered in unusually hazardous areas where other means of hazard control are not suitable. Such systems should meet the requirements of NFPA 69, *Standard on Explosion Prevention Systems*.

B-5 Fire-Fighting Operations. Hose streams should be used with great care to avoid creating dust clouds or causing structural damage to bins. Fog nozzles should be used.

B-6 Those individuals responsible for manual fire suppression at these types of facilities should have a fire protection plan. This plan should meet the recommendations contained in the National Grain and Feed Association Research Report, *Emergency Preplanning and Fire Fighting Manual — A Guide for Grain Elevator Operators and Fire Department Officials*.

Appendix C Supplemental Information on Fumigation

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

C-1 Definitions.

C-1.1 Fumigants as used in this standard are substances or mixtures that rapidly or progressively produce gases or vapors to control identified insects or other pests. Carbon dioxide and heat treatment and the use of diatomaceous earth are not included in this definition.

C-1.2 Pesticides, herbicides, and rodenticides are not considered to be fumigants. See NFPA 43D, *Code for the Storage of Pesticides*, for information on storage of pesticides.

C-1.3 Fumigation is a process whereby commodities stored in a space, or the space itself, are subjected to the vapors, fumes, or gases produced by or from fumigants.

C-2 Regulatory Usage.

C-2.1 Fumigants should not be used in any manner inconsistent with registered label or labeling.

C-2.2 The manner in which fumigants are sold, used, applied, stored, shipped, or otherwise handled, including disposal procedures, and the manner in which fumigations are conducted, is governed directly by the language of the label or labeling under which a fumigant is registered with the U.S. Environmental Protection Agency, Pesticide Registration Division, Washington, DC. It is a violation of federal law for any pesticide, including those registered as fumigants, to be used in any manner inconsistent with the registered label or labeling.

C-3 Fire and Explosion Prevention and Protection.

C-3.1 A thorough cleanup should be made, and all refuse, oily waste, and other combustible material, except that needing fumigation, should be removed from the area to be fumigated prior to the sealing of the premises.

C-3.2 All fire protection equipment such as sprinklers, alarms, and fire pumps should remain in an operating condition during fumigation.

C-3.3 While the space is being sealed and during the fumigation and ventilation period, the use of matches, smoking materials, fires, and open flames, including flame-powered fumigant gas detection devices and any similar source of ignition, should be prohibited.

C-3.4 If it is necessary to heat the enclosure being fumigated during the fumigation, only enclosed steam or hot water systems should be used. The boiler thermostats should be effectively sealed off from the area being fumigated.

C-3.5 When buildings or other enclosures in which electrical powered equipment is located are being fumigated, all switches controlling electrical power to the portion of the building being fumigated should be locked in the open position or all current-carrying conductors disconnected prior to fumigation.

Exception: Electrical equipment that is explosionproof or rated for the area need not be locked out prior to and during fumigation.

C-3.6 Temporary remote control power leads with control switches located outside the fumigated space should be installed for powering circulating fans in the fumigated space. Such fans should be approved for the intended use.

C-3.7 Control valves for gas, oil, or other fuel systems, if in the area of fumigation, should be closed prior to the beginning of the fumigation operation.

C-4 Storage and Handling.

C-4.1 Fumigants, whether packaged in cartons, drums, bulk tanks, or other containers, should be stored in locked, dry, well-ventilated, enclosed areas.

C-4.2 Fire hazards as well as life and health hazards are caused by the misuse of fumigants. Direct contact of metal phosphide fumigants to water, acids, or many other liquids can cause rapid generation of hydrogen phosphide and a fire. Piling of tablets, pellets, prepacked ropes, or dust from their fragmentation can cause a temperature increase and confine the release of gas so that ignition could occur.

C-4.3 Fumigant storage areas should be properly posted to indicate the hazardous nature of the material being stored.

C-4.4 When fumigants are being handled, smoking, matches, open flames, or other sources of ignition should be prohibited in the vicinity of such handling. Metal phosphide fumigant containers should be opened outside or near well-ventilated areas and should be protected from water exposure. These containers should not be opened in a hazardous atmosphere.

C-4.5 Metal phosphide fumigants can react with water. Therefore, fumigation using metal phosphides should be avoided in wet grain. Containers of metal phosphide fumigants should be opened in open air as, under certain conditions, they can flash upon opening.

C-4.6 When fumigants are transferred from storage areas to the area of application, to commodities, or for space fumigation, only a quantity sufficient for a reasonable period of need should be moved. Unused fumigants should be returned to storage or disposed of as directed on the label.

C-5 Hazard Warning.

C-5.1 All areas where fumigants are stored should be posted, utilizing warning placards in accordance with NFPA 704, *Standard System for the Identification of the Fire Hazards of Materials*.

C-5.2 It is preferable that fumigant storage areas should be located in a secured, detached outside building built of noncombustible construction.

C-5.3 All areas where fumigants are in use should be placarded according to the fumigant label.

Appendix D Employee Health and Safety

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

D-1 Employee health and safety in operations depend on the recognition of actual or potential hazards, controlling or eliminating these hazards, and training employees to work safely.

D-2 The following guidelines are recommended for the recognition, evaluation, and control of actual or potential hazards.

D-2.1 Training programs should be instituted to properly inform employees about the hazards involved in starch plants with emphasis on the following areas:

- Fire and dust explosion hazards,
- Sources of ignition and their control,
- Confined spaces and bin entry and cleaning,
- Fumigation,
- Housekeeping, and
- Fire protection equipment.

D-2.2 Emergency procedures to be followed in case of fire or explosion should be established. All employees should be thoroughly indoctrinated in these procedures.

D-2.3 Procedures should be established for the recognition and control of employee exposure to air contaminants.

D-2.4 Procedures should be established for locking out equipment under any conditions where start-up of such equipment might subject employees to a hazardous situation.

D-2.5 The work area should be maintained in as clean, orderly, and sanitary a manner as working conditions allow.

D-2.6 Personal protective equipment should be required for each employee wherever bodily injury or health hazard is a possibility.

Appendix E Schematics of Typical Pneumatic Conveying Installations

This Appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.

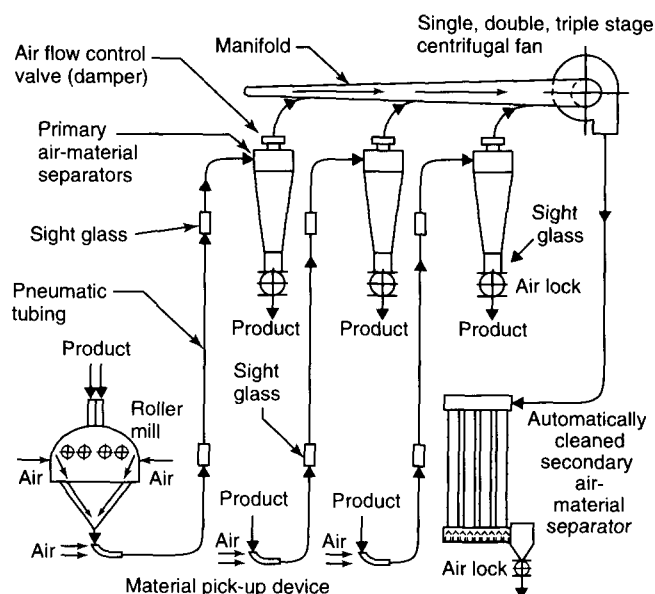


Figure E-1 Multiple strand system, NEGATIVE PRESSURE TYPE, typical for cereal mills.

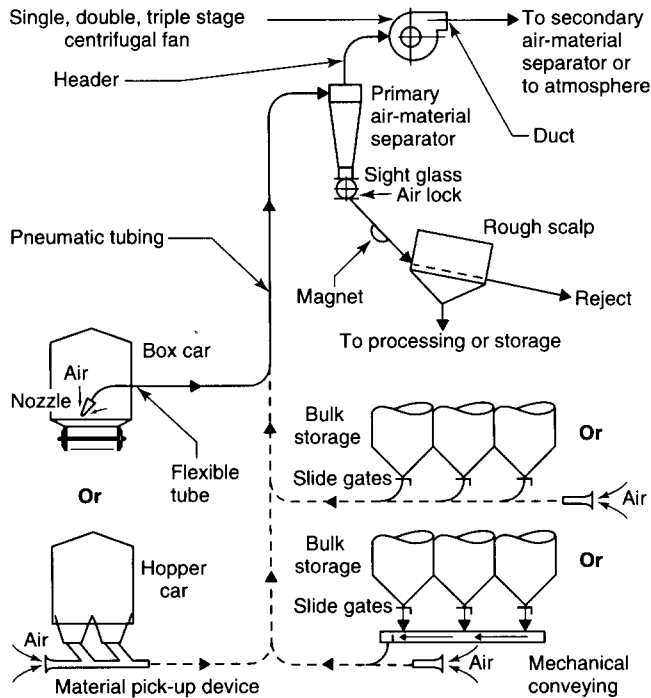


Figure E-2 Typical car unloader system, **NEGATIVE PRESSURE TYPE**, low capacity.

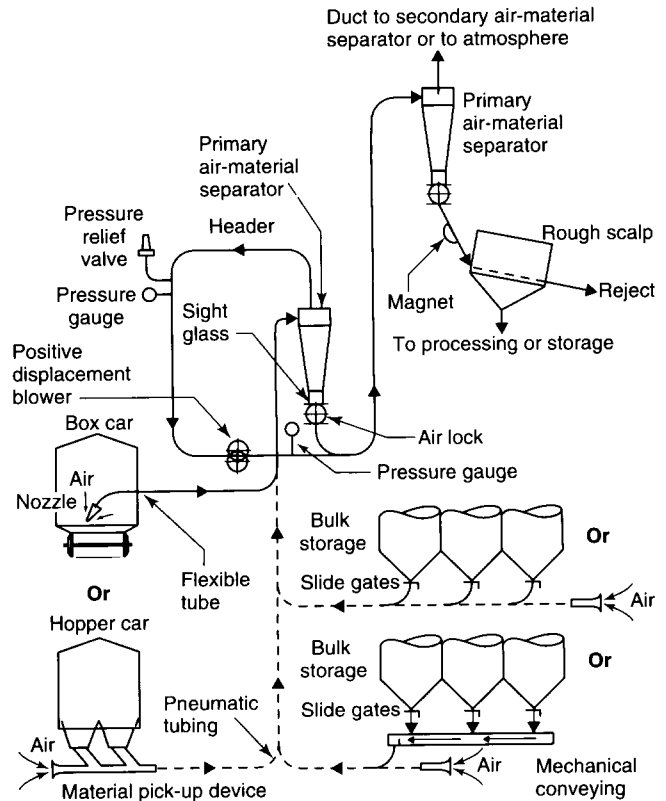


Figure E-4 Portable car unloader and transfer system, **combination NEGATIVE PRESSURE TYPE and POSITIVE PRESSURE TYPE**, high capacity.

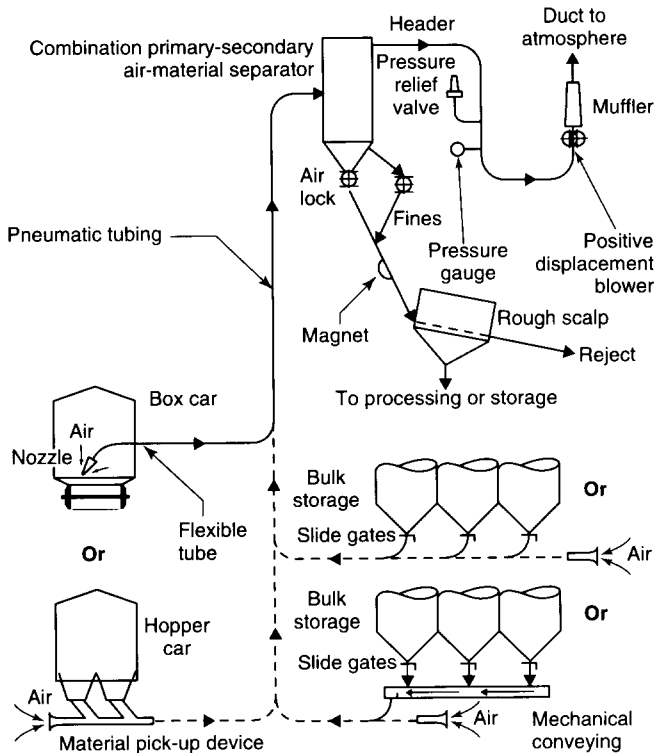


Figure E-3 Typical car unloader system, **NEGATIVE PRESSURE TYPE**, high capacity.

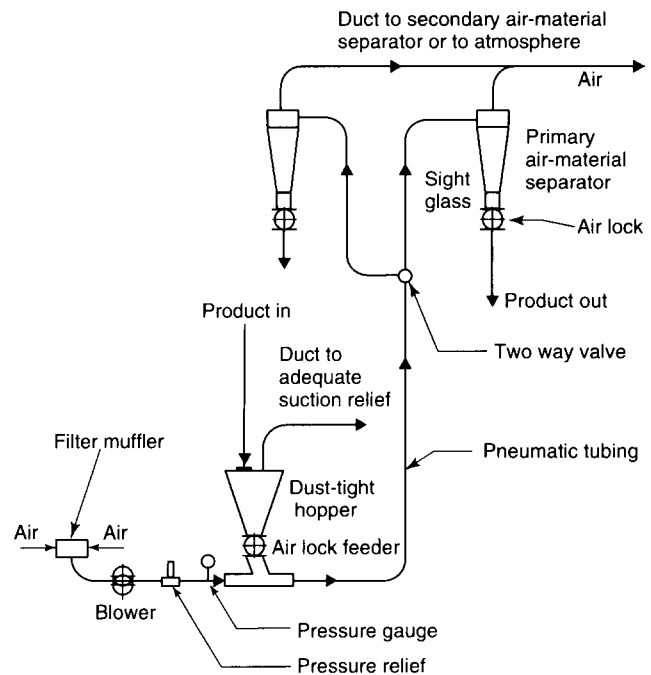


Figure E-5 Typical transfer system, **POSITIVE PRESSURE TYPE**, high capacity.

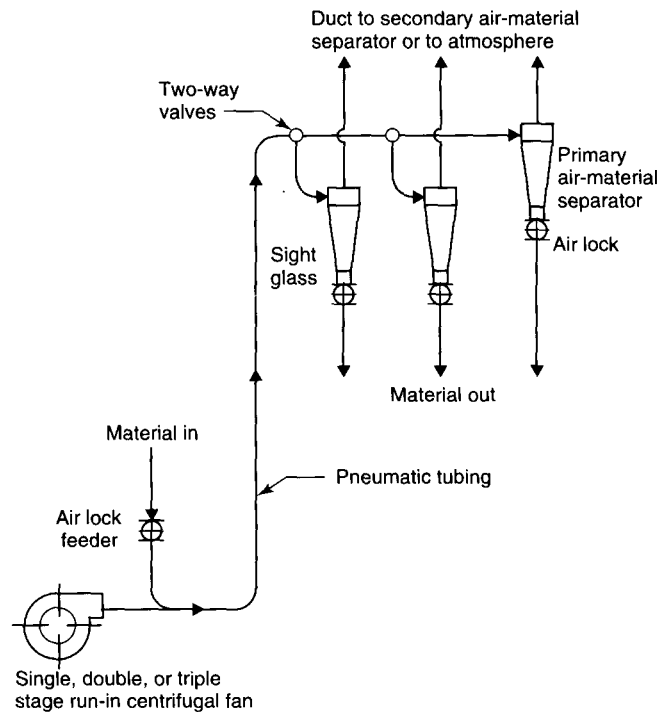


Figure E-6 Typical transfer system, POSITIVE PRESSURE TYPE, low capacity.

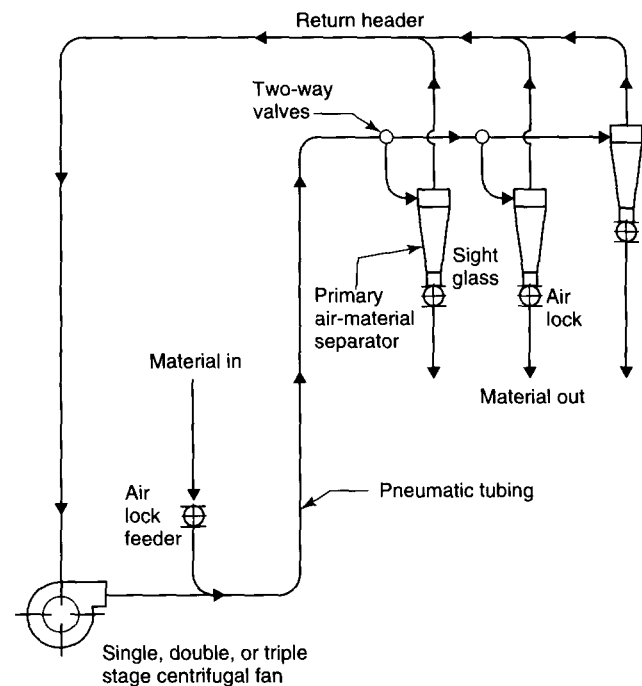


Figure E-8 Typical recirculating transfer system, POSITIVE PRESSURE TYPE, low capacity.

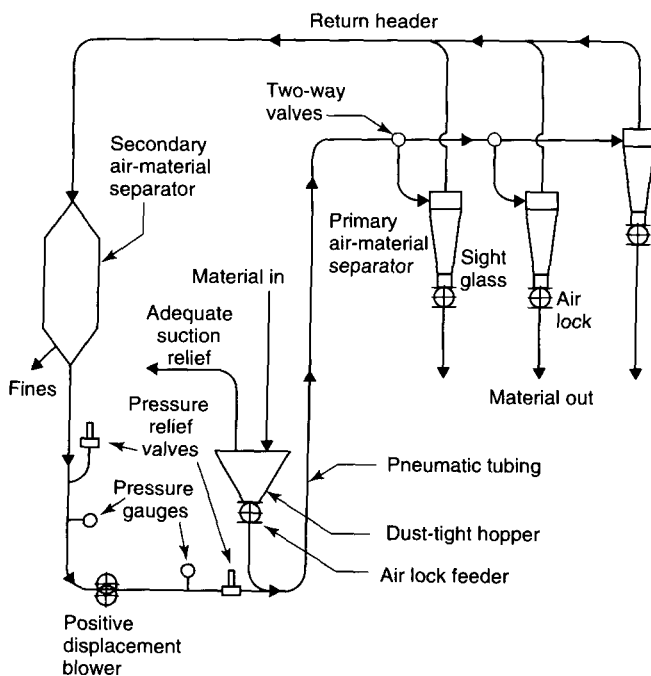


Figure E-7 Typical recirculating transfer system, POSITIVE PRESSURE TYPE, high capacity.

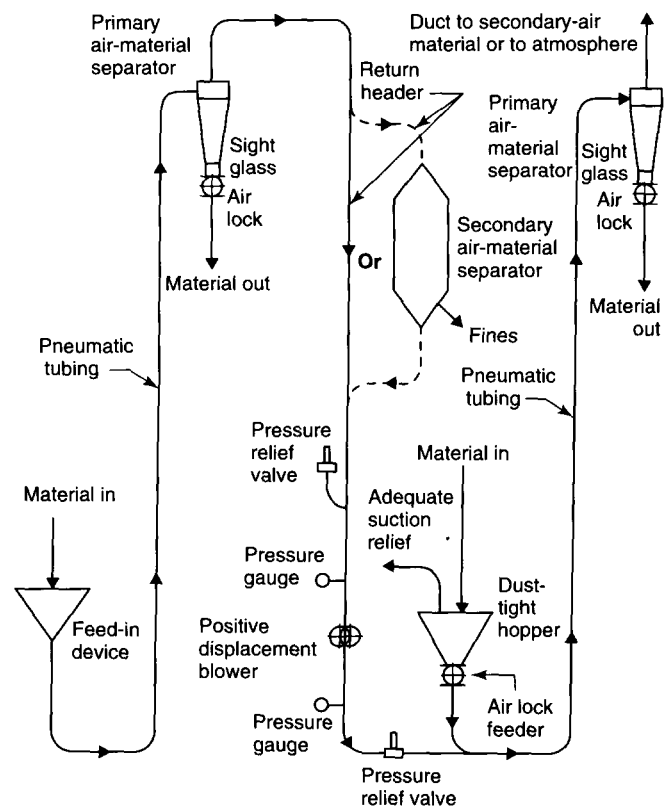


Figure E-9 Typical transfer system, combination POSITIVE PRESSURE TYPE and NEGATIVE PRESSURE TYPE, high capacity.

Appendix F Referenced Publications

F-1 The following documents or portions thereof are referenced within this standard for informational purposes only and thus are not considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

F-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 1994 edition.

NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, 1993 edition.

NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*, 1990 edition.

NFPA 43D, *Code for the Storage of Pesticides*, 1994 edition.

NFPA 51B, *Standard for Fire Prevention in Use of Cutting and Welding Processes*, 1994 edition.

NFPA 58, *Standard for the Storage and Handling of Liquefied Petroleum Gases*, 1995 edition.

NFPA 68, *Guide for Venting of Deflagrations*, 1994 edition.

NFPA 69, *Standard on Explosion Prevention Systems*, 1992 edition.

NFPA 72, *National Fire Alarm Code*, 1993 edition.

NFPA 77, *Recommended Practice on Static Electricity*, 1993 edition.

NFPA 86, *Standard for Ovens and Furnaces*, 1995 edition.

NFPA 91, *Standard for Exhaust Systems for Air Conveying of Materials*, 1995 edition.

NFPA 220, *Standard on Types of Building Construction*, 1995 edition.

NFPA 231, *Standard for General Storage*, 1995 edition.

NFPA 231C, *Standard for Rack Storage of Materials*, 1995 edition.

NFPA 497B, *Recommended Practice for the Classification of Class II Hazardous (Classified) Locations for Electrical Installations in Chemical Process Areas*, 1991 edition.

NFPA 601, *Standard on Guard Service in Fire Loss Prevention*, 1992 edition.

NFPA 650, *Standard for Pneumatic Conveying Systems for Handling Combustible Materials*, 1990 edition.

NFPA 704, *Standard System for the Identification of the Fire Hazards of Materials*, 1990 edition.

F-1.2 Other Publications.

F-1.2.1 AMCA Publication. Air Movement and Control Association, 30 West University Drive, Arlington Heights, IL 60004.

AMCA *Standards Handbook* 99-0401-86, Classification for Spark-Resistant Construction, 1986.

F-1.2.2 ANSI Publication. American National Standards Institute, 11 West 42nd Street, New York, NY 10036.

ANSI B56.1, *Safety Standard for Low Lift and High Lift Trucks*, 1993.

F-1.2.3 ASME Publication. American Society of Mechanical Engineers, 345 East 47th Street, New York, NY 10017.

ASME *Unfired Boiler and Pressure Vessel Code*, Section VIII, 1992.

F-1.2.4 ASTM Publication. American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103-1187.

ASTM E 1226, *Standard Test Method for Pressure and Rate of Pressure Rise for Combustible Dusts*, 1992.

F-1.2.5 Factory Mutual Research Corporation Publications. Factory Mutual Research Corporation, 1151 Boston-Providence Turnpike, Norwood, MA 02062.

Approval Standard for Electrical Battery Powered Industrial Trucks, Types E and EE.

Approval Standard for Gasoline or Diesel Engine-Powered Industrial Trucks, Types G, GS, D, or DS.

Approval Standard for LP-Gas Engine-Powered Industrial Trucks, Types LP and LPS.

F-1.2.6 National Grain and Feed Association Publication. National Grain and Feed Association, 725 15th Street, NW, Suite 500, Washington, DC 20005.

Emergency Preplanning and Fire Fighting Manual — A Guide for Grain Elevator Operators and Fire Department Officials, 1987.

F-1.2.7 UL Publications. Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062.

UL 558, *Standard for Internal Combustion Engine-Powered Industrial Trucks*, 1991.

UL 583, *Standard for Electric-Battery Powered Industrial Trucks*, 1991.

F-1.2.8 U.S. Government Publication. U.S. Government Printing Office, Superintendent of Documents, Washington, DC 20402.

Code of Federal Regulations, Title 29, Part 1910.272.

Index

© 1995 National Fire Protection Association, All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document which it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

- A-**
- Access doors/openings**
 - Bins, tanks, and silos 2-5.3 to 2-5.4
 - Grain dryers 6-2.2.5
 - Heat exchangers 7-1.3
 - Legs 5-4.2.4 to 5-4.2.6, A-5-4.2.5
 - Starch dryers 6-4.2.2
 - Water extinguishing through A-10-6.2(a)
 - Agricultural dusts**
 - Definition 1-4, A-1-4
 - Emissions 8-2, A-8-2.1, A-8-2.2
 - Explosion hazards 4-2.1, A-4-2.1, A-6-3.1, A-6-4.2.1, Table A-4-2.1
 - Ignition hazards A-6-1, A-6-3.1, A-6-4.2.1, A-7-1.4
 - Removal of layered 8-1, A-8-1.3
 - Return to system 8-2.2 to 8-2.3, A-8-2.2
 - Air heating systems, grain dryer** 6-2.3, A-6-2.3.1 to A-6-2.3.2
 - Air-material separators** 9-4, A-9-4.2
 - Alignment monitors** 5-4.2.13, A-5-4.2.8, A-5-4.2.13
 - Applicability of standard** 1-3
 - Approved (definition)** 1-4, A-1-4
 - Authority having jurisdiction (definition)** 1-4, A-1-4
- B-**
- Bearings** 5-1, A-5-1.3
 - Extinguishment method for 10-6.4
 - Monitoring systems A-5-4.2.8
 - Belts** *see also* Conveyors
 - Alignment monitoring devices A-5-4.2.8
 - Drive 5-2
 - Fire-resistant belting material (definition) 1-4
 - Bin decks, means of egress for** 2-4.1.2
 - Bins**
 - Concrete, extinguishment methods for A-10-6.2(d)
 - Construction 2-5, A-2-5.2
 - Dust collectors 8-3.2
 - Dust storage 8-3.9, A-8-3.9
 - Enclosures 8-2.1.2
 - Overflow systems 5-4.2.14
 - Venting 2-5.2, 3-2, 4-2.1, A-2-5.2, A-3-2.2, A-4-2.1
 - Bonding, electrical**
 - Pneumatic conveying systems 9-2.1, A-9-2.1
 - Processing machinery and equipment 5-5.1.3, A-5-5.1.3
 - Transport modes 9-5.1, A-9-5.1
 - Boot sections, elevator**
 - Access doors 5-4.2.5, A-5-4.2.5
 - Dust control 8-2.1.1
 - Dusttightness of 5-4.2.4, A-5-4.2.5
 - Water extinguishing in A-10-6.2(a)
 - Bucket elevators** 5-4, A-5-4.1.2, A-5-4.1.3
 - Bulk raw grain, handling 5-4.1, A-5-4.1.2, A-5-4.1.3
 - Dust control in 8-2.1.1, 8-2.2 to 8-2.3, A-8-2.2
 - Explosion venting A-4-3.3
 - Extinguishment methods for A-10-6.2(a)
 - Motors and drive trains 5-4.2.7, A-5-4.2.7
 - Building fire protection** Chap. 10, A-10
 - Bulk material conveyors** 5-3.2, A-5-3.1
 - Bulk raw grain**
 - Definition 1-4
 - Legs handling 5-4.1, A-5-4.1.2, A-5-4.1.3
 - Burning materials, removal of** 6-2.2.6 to 6-2.2.7, 10-6.2, A-10-6.2(c) to (d)
- C-**
- Chemical fires** A-10-6.2(e)
 - Cleaning** 8-1, A-8-1.3
 - Engine and motor-driven equipment 11-5.5, A-11-5.5
 - Heat exchangers 7-1.3
 - Process machinery and equipment 5-5.1.4
 - Product dryers 6-4.2.2 to 6-4.2.3
 - Work areas D-2.5
 - Comfort heating** 7-2
 - Compressed air** 8-1.2
 - Construction requirements** Chap. 2, 6-2.2, A-2
 - Containment, explosion** 4-3.1 to 4-3.2, 5-4.1.3
 - Contractors, outside** 11-8, A-11-8
 - Conveyors** 5-3, A-5-3.1
 - Extinguishment methods for A-10-6.2(b)
 - Pneumatic conveying Chap. 9, A-9
- D-**
- Dampers, fire** 2-3.2
 - Definitions** 1-4, A-1-4
 - Detection systems, dryer** *see* Fire detection systems, dryer
 - Doors**
 - Access *see* Access doors/openings
 - Fire 2-3.2
 - Drag conveyors** 5-3.1, 5-5.1.5
 - Drive belts** 5-2
 - Dryers** Chap. 6, A-6
 - Emergency unloading 6-2.2.6 to 6-2.2.7
 - Explosion suppression 6-5.3, A-6-5
 - Extinguishment methods for *see* Extinguishment methods, fire
 - Fire-detection equipment *see* Fire detection systems, dryer
 - Grain 6-2, A-6-2
 - Inspection and testing 6-5, A-6-5
 - Product 6-3, A-6-3.1
 - Starch 6-4, A-6-4
 - Dust collection systems** 8-3, A-8-3
 - Used with ventilation systems 3-1.3, 3-2.1, 8-2.1.2
 - Dust control** Chap. 8, A-8
- E-**
- Egress, means of** 2-4
 - Electrical equipment** 2-1.3, 11-1, A-11-1.2
 - Pneumatic conveying 9-2.2
 - Transport modes 9-5.2, A-9-5.2
 - Electrical wiring** *see* Wiring
 - Electricity, static** *see* Static electricity
 - Elevators**
 - Bucket *see* Bucket elevators
 - Enclosures for 2-4.2
 - Emergency dump** 6-2.2.6, A-10-6.2(c)
 - Emergency preplanning** 10-5
 - Emergency procedures** D-2.2 to D-2.4
 - Employees**
 - Health and safety App. D
 - Training 10-5.2, D-2.1
 - Enclosures**
 - Construction of 2-1.2, A-2-1.2
 - Explosion venting 4-2, A-4-2
 - Handling facilities 8-2.1.2
 - Heat exchangers 7-1.3

Engine equipment 11-5, A-11-5.2, A-11-5.4
En-masse conveyors 5-3.1, 5-5.1.5
Equipment Chap. 5, A-5
 Explosion prevention for 4-3
Equivalency 1-2.2
Evacuation 2-4, 10-6.3
Excess temperature limit controls 6-2.4.2
Exhaust systems *see* Recirculating exhaust air systems;
 Ventilation and venting
Explosion prevention Chap. 4, A-4, C-3
Explosion relief panels 4-2.2
 Exterior legs 5-4.1.2, 5-4.2.2, A-5-4.1.2
Explosion relief windows 4-2.2
Explosion venting 2-1.2, 2-5.2, 4-3.3, A-2-1.2,
 A-2-5.2, A-4-3.3
 Bucket elevators 5-4.1.3, 5-4.2.1 to 5-4.2.3, A-5-4.1.2,
 A-5-4.1.3
 Dust storage bins/tanks 8-3.9, A-8-3.9
 Starch dryers A-6-4.4.1
Explosions (definition) 1-4
Exterior legs 5-4.1.2, 5-4.2.2, A-5-4.1.2
Extinguishment methods, fire
 Bearings 10-6.4
 Buildings 10-6.2, A-10-6.2
 Grain dryers 6-2.2.7, 6-2.6.3, A-6-2.6.3
 Inspection and tests 6-5.2, A-6-5
 Starch dryers 6-4.4, A-6-4.4.1

-F-

Filtered air
 Dust collection systems 8-3.8, A-8-3.8
 Pneumatic conveying systems 9-4.2, A-9-4.2
Filters 8-3.8.2, 9-4.2.2
 Dust 3-1.2, 8-3.1 to 8-3.3, A-8-3.5
 Hammermill 9-4.2.4, A-9-4.2.4
 Pneumatic conveying systems 9-4.2.2 to 9-4.2.5, A-9-4.2
Fire dampers 2-3.2
Fire detection systems, dryer
 Grain dryers 6-2.6.1 to 6-2.6.2
 Inspection and tests 6-5.1, A-6-5(a)
 Starch dryers 6-4.3.1
Fire doors 2-3.2
Fire extinguishers, portable 10-1, A-6-2.6.3(f)
Fire protection App. B
 Building Chap. 10, A-10
 Fumigation operations C-3
 Grain dryers 6-2.6
 Starch dryers 6-4.3 to 6-5, A-6-4.4.1, A-6-5
Fire shutters 2-3.2
Fire walls 2-3.1 to 2-3.2
Fire-fighting operations 10-6, A-10-6.2, B-5
Fire-resistant belting material (definition) 1-4
Fixed water spray systems A-6-2.6.3
Flammable and combustible liquids, storage of 11-7, A-11-7.2
Floor sweeps 8-3.10, A-8-3.10
Fog nozzles B-5
Fuel systems, heating system 6-2.3.6, 6-3.4
Fumigant fires A-10-6.2(e)
Fumigation App. C

-G-

Grain dryers 6-2, A-6-2
Grounding, electrical
 Pneumatic conveying systems 9-2.1, A-9-2.1
 Processing machinery and equipment 5-5.1.3, A-5-5.1.3
 Transport modes 9-5.1, A-9-5.1

-H-

Hammermills 9-4.2.4, A-9-4.2.4
Handling, of fumigants C-4, C-5.3

Handling facilities
 Construction 2-1.5
 Enclosures 8-2.1.2
Headhouses/sections
 Construction 2-1.5.3 to 2-1.5.4
 Dusttightness 5-4.2.4
 Explosion relief areas 2-1.5.4
 Water extinguishing in A-10-6.2(a)
Heat transfer systems 7-1, A-7-1.2.1, A-7-1.4
Heating systems Chap. 7, A-7
Hold-open devices, door 2-3.2.2
Horizontal surfaces 2-2, A-2-2
Hose lines 10-4.1, A-6-2.6.3
Hot work 11-2, A-11-2
 Definition 1-4
Hydrants B-3

-I-

Ignition sources
 Product dryers A-6-3.1
 Starch dryers 6-4.2, A-6-4.2.1
Ignition temperature, of dusts A-6-1, A-7-1.4
Inerting 4-3.1 to 4-3.2, 5-4.1.3, A-10-6.2(e)
Inside legs 2-1.5.3.1
Inspection
 Product dryers 6-4.2.2 to 6-4.2.3
Inspection, dryer protection systems 6-5, A-6-5
Inspection openings *see* Access doors/openings
Interior legs 5-4.1.3, 5-4.2.3, 5-4.2.13, A-5-4.1.3, A-5-4.3.13
Interior surfaces *see also* Walls, interior
 Construction 2-2, A-2-2
 Of dryers 6-2.2.3, 6-3.1, A-6-3.1
Interlocks, safety 6-4.3.2

-L-

Labeled (definition) 1-4
Lagging 5-3.2, 5-4.2.12
Legs *see* Bucket elevators
Listed (definition) 1-4, A-1-4
Location
 Dust collectors 8-3.2
 Dust storage bins/tanks 8-3.9
 Grain dryers 6-2.1, A-6-2.1
 Heat exchangers 7-1.4
 Personnel-intensive areas 2-1.5.1 to 2-1.5.4
 Receiving, shipping, handling, and storing facilities 2-1.5
LP-Gas
 Burners 6-2.3.5
 Storage of 11-7, A-11-7.2

-M-

Manlifts, enclosures for 2-4.2
Marine towers
 Construction 2-6
 Definition 1-4
Masonry construction 2-1.4, A-2-1.4
Means of egress 2-4
Motion detector devices 5-4.2.8, 5-4.2.13, A-5-3.1, A-5-4.2.8,
 A-5-4.2.13
Motor-driven equipment 11-5, A-11-5.2, A-11-5.4
Multiple-direction valves 9-3.4

-N-

Nonaqueous agents A-10-6.2(e)

-O-

Ohms per square (definition) 1-4
Oils, storage of 11-7, A-11-7.2
Openings
 Access/inspection *see* Access doors/openings
 Fire walls/partition 2-3.2

Outside contractors	11-8, A-11-8
Overflow systems, bins	5-4.2.14

-P-

Penetration seals	2-3.2
Permits, hot work	11-2.2 to 11-2.4
Personal protective equipment	D-2.6
Personnel-intensive areas	2-1.5.1 to 2-1.5.4
Phosphine fires	A-10-6.2(e)
Piping, pneumatic conveying systems	9-3
Pits	
Dust collection system	8-3.6, A-8-3.6
Explosion venting	4-2.1
Plans	
Emergency preplanning	10-5
Fire protection	B-6
Pneumatic conveying systems	Chap. 9, A-9, App. E
Pneumatic filters	9-4.2.3, A-9-4.2.3
Power equipment	<i>see</i> Electrical equipment
Pressure-relief valves	9-3.3
Processing machinery and equipment	5-5, A-5-5
Product dryers	6-3, A-6-3.1
Product purifiers	8-3.2, 9-4.2.5, A-9-4.2.5
Propellant-actuated tools	11-3
Purpose of standard	1-2, A-1-2.1

-R-

Receiving conveyances	9-5, A-9-5
Receiving facilities	
Construction	2-1.5, 5-5.1.1, A-5-5.1
Recirculating exhaust air systems	3-1.2, 6-2.2.4, 8-3.8, 9-4.2, A-8-3.8, A-9-4.2
Referenced publications	Chap. 12, App. F
Roofs	
Means of egress	2-4.1.2
Water fog applied to	A-10-6.2(d)

-S-

Safety controls, grain dryers	6-2.4
Scope of standard	1-1, A-1-1
Screw conveyors	5-3.1, 5-5.1.5
Shafts, noncombustible	2-4.2
Shall (definition)	1-4
Shipping conveyances	9-5, A-9-5
Shipping facilities	<i>see</i> Receiving facilities
Should (definition)	1-4
Shutters, fire	2-3.2
Silos	
Concrete, extinguishment methods for	2-5, A-2-5.2
Venting	A-10-6.2(d)
Water gas reaction in	2-5.2, 3-2, 4-2.1, A-2-5.2, A-3-2.2
Water gas reaction in	A-10-6.2(f)
Smoking	11-6, A-11-6, C-4.4
Spark arresters	11-5.3, 11-5.5.2
Spark-producing tools	11-3
Spontaneous ignition	A-6-3.1, A-6-4.2.1
Spouts	5-3.3 to 5-3.5, 5-4.2.11, 5-4.2.14, A-5-3, A-5-3.5
Marine towers	2-6.4
Tributary	5-5.1.2, A-5-5.1.2
Sprinkler systems	2-3.1, 10-2, B-1
Grain dryers	A-6-2.6.3
Heat transfer systems	7-1.2.2

Stairs, enclosures for	2-4.2
Standpipe and hose systems	10-4, A-10-4.3
Starch (definition)	1-4
Starch dryers	6-4, A-6-4
Starch manufacturing and handling	
Dust collection system	8-3.5, A-8-3.5
Hazards of	D-2.1
Processing machinery and equipment	5-5.2
Static electricity ...	5-5.1.3, 9-2.1, 11-4, A-5-5.1.3, A-9-2.1, A-11-4
Steam smothering systems	A-6-2.6.3(e)
Storage	
Construction of facilities	2-1.5, 2-3.1
Enclosures	8-2.1.2
Of fumigants	C-4, C-5.1 to C-5.2
Miscellaneous	11-10
Of oils, flammable liquids, and LP-Gas,	11-7, A-11-7.2
Subterranean tunnels	<i>see</i> Tunnels
Supervisory services	10-3, B-2
Supplemental requirements	Chap. 11, A-11
Suppressants, dust control	8-2.1, A-8-2.1
Suppression, explosion	4-3.1 to 4-3.2, B-4
Inspection and tests	6-5.3, A-6-5
Interior legs	5-4.1.3, A-5-4.1.3
Starch dryers	6-4.4.1, 6-5.3, A-6-4.4.1, A-6-5

-T-

Tanks	
Construction	2-5, A-2-5.2
Dust collectors for	8-3.2
Dust storage	8-3.9, A-8-3.9
Steel, extinguishment methods for	A-10-6.2(d)
Venting	2-5.2, 3-2, A-2-5.2, A-3-2.2
Testing, dryer protection systems	6-5, A-6-5
Tools, spark-producing and propellant-actuated	11-3
Training, employee	
Emergency procedures	10-5.2
Starch plants, hazards of	D-2.1
Tunnels	
Construction over	2-1.5.2
Explosion venting	4-2.1
Means of egress	2-4.1.1

-V-

Vacuum cleaning systems	8-1.3, A-8-1.3
Vacuum-relief valves	9-3.3
Valves, pneumatic conveying systems	9-3.3 to 9-3.4
Ventilation and venting	Chap. 3, 8-2.1.2, A-3-2.2;
<i>see also</i> Explosion venting;	
Recirculating exhaust air systems	
Vertical surfaces	A-2-2

-W-

Walls, interior	2-3, A-10-6.2(d)
Warehouse areas	2-3.1
Warning signs	11-9, C-5
Water extinguishing systems	A-10-6.2(a) to (d)
Water fog extinguishment ..	10-6.4, A-10-6.2(a), A-10-6.2(d), B-5
Water gas reaction	A-10-6.2(f), C-4.5
Water spray systems, fixed	A-6-2.6.3
Windows, explosion relief	4-2.2
Wiring	2-1.3, 9-2.2, 11-1, A-11-1.2